

**Districtwide Lead in Drinking Water
Sampling and Remediation Plan for the 2023-2025
Compliance Period**

Huntington UFSD

February 2025

Enviroscience Project #25852



2150 Smithtown Ave., Suite 3, Ronkonkoma, NY 11779

T: 631.580.3191 • **F:** 631.580.3195 • **W:** envirohealth.org

DISTRICTWIDE LEAD IN DRINKING WATER SAMPLING AND REMEDIATION PLAN FOR THE
2023-2025 COMPLIANCE PERIOD

FEBRUARY 2025

ENVIROSCIENCE PROJECT #25852

Prepared for: HUNTINGTON UFSD
Oakwood & McKay Roads
Huntington, NY 11745

Prepared by: ENVIROSCIENCE CONSULTANTS, LLC
2150 Smithtown Avenue
Ronkonkoma, New York 11779
(631) 580-3191

Project Manager: *Pam Chadderton*

TABLE OF CONTENTS

<u>Section</u>	<u>Title</u>
1.0	Executive Summary
2.0	Sampling Methodology
3.0	Initial Results

Appendices

Appendix A	Flower Hill Primary School
Appendix B	Jefferson Primary School
Appendix C	Southdown Primary School
Appendix D	Washington Primary School
Appendix E	Jack Abrams STEM Magnet School
Appendix F	Woodhull Intermediate School
Appendix G	J. Taylor Finley School
Appendix H	Huntington High School

1.0 EXECUTIVE SUMMARY

The Huntington UFSD has developed their Lead in Drinking Water Sampling and Remediation Plan for the 2023-2025 compliance period, as required by the New York State Department of Health (Public Health Law Sections 1370-a and 1110, Subpart 67-4 Lead Testing in School Drinking Water).

In accordance with the regulation, this Lead Remediation Plan is prepared to identify locations deemed as Applicable Drinking Water Sources and report first draw sample results, to mitigate locations where sample results exceed 5 parts per billion, to identify locations deemed as Non-Applicable Water Sources, communicate this designation to building occupants, and to develop strategies for monitoring locations deemed Non-Applicable Water Sources to insure building occupants do not consume water from these locations.

The following locations within the Huntington UFSD buildings have been deemed Applicable Drinking Water Sources by the administration:

- 1) Water fountains and bottle filling stations;
- 2) Kitchen water faucets and pot fillers used in food preparation;
- 3) Ice machines
- 4) Home Economics classroom sinks
- 5) Nurse's Office and Faculty Room sinks

First draw samples were collected from each of these locations within the district and analyzed by a New York State Department of Health ELAP certified laboratory. The chains of custody are available upon request. For results at or below 5 ppb, no further action is required until 2025. For locations above 5 ppb, options include: second and third draw sample collection to determine source of lead, designation of the location as Non-applicable Water Source, or permanent removal of the fixture from the location. In either case, the result was communicated by Enviroscience Consultants, and the fixture was shut off by the district immediately upon receipt of results.

The following locations within the Huntington UFSD buildings were deemed Non-Applicable Water Sources by the administration:

- 1) Science Laboratory sinks
- 2) Art Room sinks
- 3) Technical Classroom sinks
- 4) Other Classroom sinks
- 5) Bathroom sinks
- 6) Outside spigots
- 7) Custodial Closet sinks
- 8) Mixed Valve sinks (or hot only)

In these cases, the Huntington UFSD staff have placed signs adjacent to the fixture to notify occupants that the water is not intended for consumption. To further support this protocol, the following management of the locations is required:

- 1) Science Laboratory sinks - communicate in writing with students that these locations are for science experiments and hand washing only, not for consumption. This is most easily accomplished by including this language in the laboratory safety paperwork distributed to students at the beginning of the school year. This program should be monitored by the respective science teachers, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 2) Art Room sinks - communicate in writing to students that these locations are for cleaning of art supplies and hand washing only, not for consumption. This is most easily accomplished by including this language in the course paperwork distributed to students at the beginning of the school year. This program should be monitored by the respective art teachers, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 3) Technical Classroom sinks - classrooms in this category often include wood shop or auto mechanics classrooms, where students are to hand wash after bathroom usage or activities as part of a regular hygiene program. This program should be monitored by teachers and staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 4) Other classroom sinks - classrooms in this category often include elementary classrooms, where students are to hand wash after bathroom usage or activities as part of a regular hygiene program. This program should be monitored by teachers and staff

to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.


- 5) Bathroom sinks - in intermediate buildings, signage should be sufficient for communicating the concept of hand washing only. In elementary schools, personal hygiene should be integrated into curriculum to ensure students understand bathroom sinks are for hand washing only, and not consumption. Further, show what the signage looks like in bathrooms, so they learn to recognize its meaning. This program should be monitored by teachers and staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 6) Outside spigots - all-weather signage will be installed at each location. Further, spigots will have a special key maintained by the custodial staff to ensure that non-authorized persons do not fill sports coolers or use hoses for consumption. This program should be monitored by custodial staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 7) Custodial Closet sinks - these locations should be accessed by custodial personnel only and locked when not in use. Access to others should be restricted. This program should be monitored by custodial staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.
- 8) Mixed Valve sinks (or hot only) – per Public Health Law Sections 1370-a and 1110, Subpart 67-4 Lead Testing in School Drinking Water mixed valve or hot water only sources are not required to be sampled. Signage is required for these sources. Signage should be sufficient for communicating the concept of hand washing only. In elementary schools, personal hygiene should be integrated into curriculum to ensure students understand bathroom sinks are for hand washing only, and not consumption. Further, show what the signage looks like so they learn to recognize its meaning. This program should be monitored by teachers and staff to ensure consumption is not taking place, and any deficiencies reported for assessment and revision, if necessary, by the Facilities Department.




All locations deemed non-applicable, but do not have signs, should be taken offline until signs have been posted. Signs are suggested to have pictures that instruct for handwashing only, do not drink.

2.0 SAMPLING METHODOLOGY

In accordance with the regulation, Enviroscience Consultants, LLC performed initial water sampling at the Huntington UFSD buildings between January 28, 2025 and January 31, 2025. Samples were collected in wide-mouth 250 milliliter containers and were collected in the morning hours before the facilities opened. The water sources were not used for at least 8 hours and not more than 18 hours prior to sampling. Unique source numbers and designations were assigned to each source location. Unique sample identification numbers were assigned to each sample taken. The key to fixture type codes, source designations, and the sampling location schematics are shown below.

Code Key for Lead in Water			
Fixture Type Codes			
BF	Bottle Filler	SK	Sink
HB	Hose Bib	SL	Supply Line
IM	Ice Machine	SP	Spigot
OS	Other Source	SPY	Spray
PF	Pot Filler	SS	Slop Sink
		V	Valve
		WC	Water Cooler
		WF	Water Fountain
Source Designations			
App	Applicable	N/A	Non-applicable

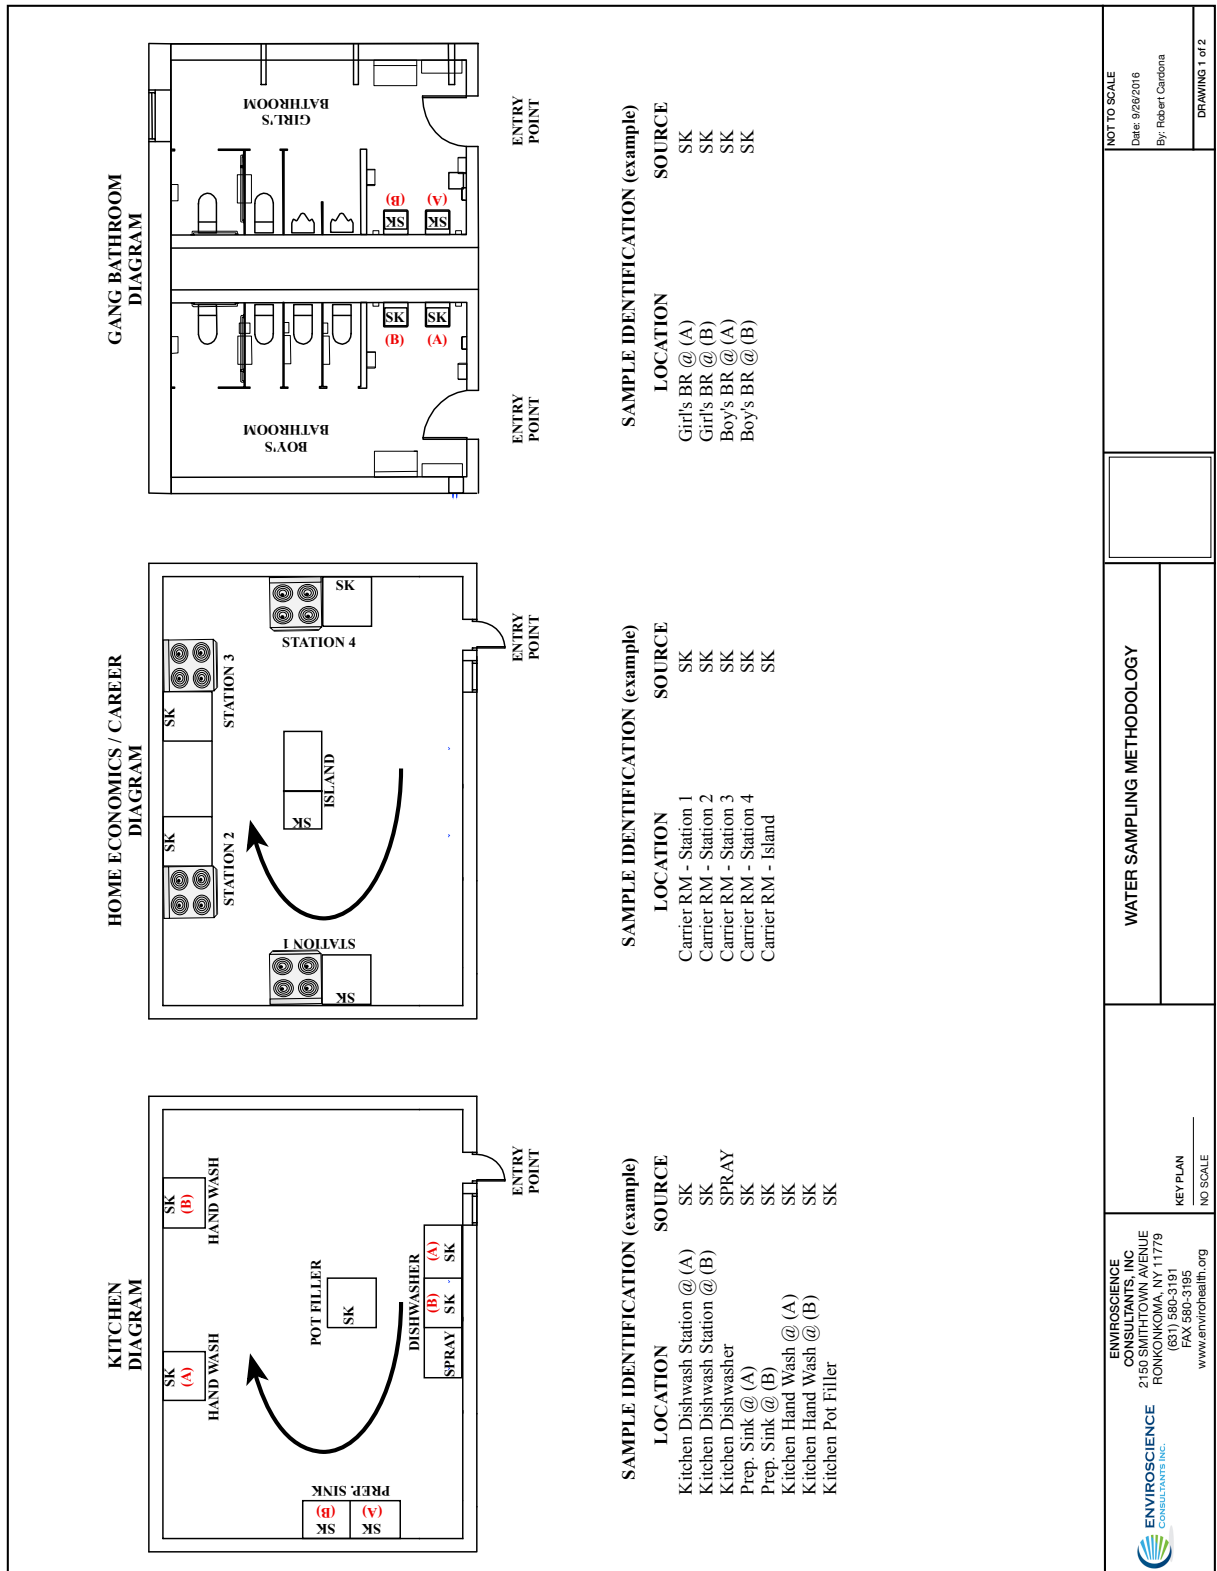
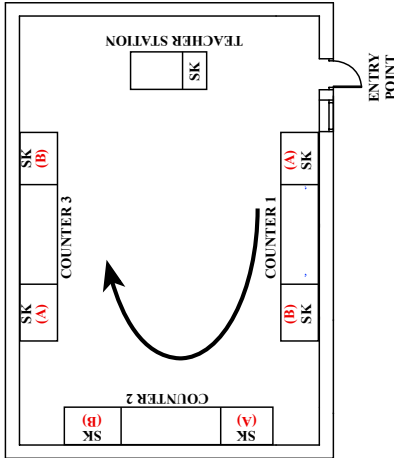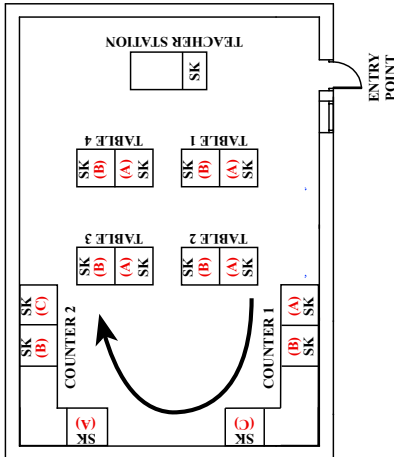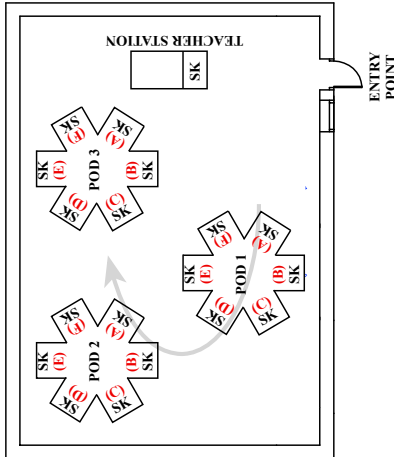
<div>SCIENCE ROOM TYPE 1 DIAGRAM</div> 	<div>SCIENCE ROOM TYPE 2 DIAGRAM</div> 	<div>SCIENCE ROOM TYPE 3 DIAGRAM</div> 																																																																																								
<div>SAMPLE IDENTIFICATION (example)</div> <table><thead><tr><th>LOCATION</th><th>SOURCE</th></tr></thead><tbody><tr><td>Room 200 - Teacher Station</td><td>SK</td></tr><tr><td>Room 200 - Counter 1 @ (A)</td><td>SK</td></tr><tr><td>Room 200 - Counter 1 @ (B)</td><td>SK</td></tr><tr><td>Room 200 - Counter 2 @ (A)</td><td>SK</td></tr><tr><td>Room 200 - Counter 2 @ (B)</td><td>SK</td></tr><tr><td>Room 200 - Counter 3 @ (A)</td><td>SK</td></tr><tr><td>Room 200 - Counter 3 @ (B)</td><td>SK</td></tr></tbody></table>	LOCATION	SOURCE	Room 200 - Teacher Station	SK	Room 200 - Counter 1 @ (A)	SK	Room 200 - Counter 1 @ (B)	SK	Room 200 - Counter 2 @ (A)	SK	Room 200 - Counter 2 @ (B)	SK	Room 200 - Counter 3 @ (A)	SK	Room 200 - Counter 3 @ (B)	SK	<div>SAMPLE IDENTIFICATION (example)</div> <table><thead><tr><th>LOCATION</th><th>SOURCE</th></tr></thead><tbody><tr><td>Room 200 - Teacher Station</td><td>SK</td></tr><tr><td>Room 200 - Table 1 @ (A)</td><td>SK</td></tr><tr><td>Room 200 - Table 1 @ (B)</td><td>SK</td></tr><tr><td>Room 200 - Table 2 @ (A)</td><td>SK</td></tr><tr><td>Room 200 - Table 2 @ (B)</td><td>SK</td></tr><tr><td>Room 200 - Table 3 @ (A)</td><td>SK</td></tr><tr><td>Room 200 - Table 3 @ (B)</td><td>SK</td></tr><tr><td>Room 200 - Table 4 @ (A)</td><td>SK</td></tr><tr><td>Room 200 - Table 4 @ (B)</td><td>SK</td></tr><tr><td>Room 200 - Counter 1 @ (A)</td><td>SK</td></tr><tr><td>Room 200 - Counter 1 @ (B)</td><td>SK</td></tr><tr><td>Room 200 - Counter 2 @ (A)</td><td>SK</td></tr><tr><td>Room 200 - Counter 2 @ (B)</td><td>SK</td></tr><tr><td>Room 200 - Counter 3 @ (A)</td><td>SK</td></tr><tr><td>Room 200 - Counter 3 @ (B)</td><td>SK</td></tr></tbody></table>	LOCATION	SOURCE	Room 200 - Teacher Station	SK	Room 200 - Table 1 @ (A)	SK	Room 200 - Table 1 @ (B)	SK	Room 200 - Table 2 @ (A)	SK	Room 200 - Table 2 @ (B)	SK	Room 200 - Table 3 @ (A)	SK	Room 200 - Table 3 @ (B)	SK	Room 200 - Table 4 @ (A)	SK	Room 200 - Table 4 @ (B)	SK	Room 200 - Counter 1 @ (A)	SK	Room 200 - Counter 1 @ (B)	SK	Room 200 - Counter 2 @ (A)	SK	Room 200 - Counter 2 @ (B)	SK	Room 200 - Counter 3 @ (A)	SK	Room 200 - Counter 3 @ (B)	SK	<div>SAMPLE IDENTIFICATION (example)</div> <table><thead><tr><th>LOCATION</th><th>SOURCE</th></tr></thead><tbody><tr><td>Room 200 - Teacher Station</td><td>SK</td></tr><tr><td>Room 200 - POD 1 @ (A)</td><td>SK</td></tr><tr><td>Room 200 - POD 1 @ (B)</td><td>SK</td></tr><tr><td>Room 200 - POD 1 @ (C)</td><td>SK</td></tr><tr><td>Room 200 - POD 1 @ (D)</td><td>SK</td></tr><tr><td>Room 200 - POD 1 @ (E)</td><td>SK</td></tr><tr><td>Room 200 - POD 1 @ (F)</td><td>SK</td></tr><tr><td>Room 200 - POD 2 @ (A)</td><td>SK</td></tr><tr><td>Room 200 - POD 2 @ (B)</td><td>SK</td></tr><tr><td>Room 200 - POD 2 @ (C)</td><td>SK</td></tr><tr><td>Room 200 - POD 2 @ (D)</td><td>SK</td></tr><tr><td>Room 200 - POD 2 @ (E)</td><td>SK</td></tr><tr><td>Room 200 - POD 2 @ (F)</td><td>SK</td></tr><tr><td>Room 200 - POD 3 @ (A)</td><td>SK</td></tr><tr><td>Room 200 - POD 3 @ (B)</td><td>SK</td></tr><tr><td>Room 200 - POD 3 @ (C)</td><td>SK</td></tr><tr><td>Room 200 - POD 3 @ (D)</td><td>SK</td></tr><tr><td>Room 200 - POD 3 @ (E)</td><td>SK</td></tr><tr><td>Room 200 - POD 3 @ (F)</td><td>SK</td></tr></tbody></table>	LOCATION	SOURCE	Room 200 - Teacher Station	SK	Room 200 - POD 1 @ (A)	SK	Room 200 - POD 1 @ (B)	SK	Room 200 - POD 1 @ (C)	SK	Room 200 - POD 1 @ (D)	SK	Room 200 - POD 1 @ (E)	SK	Room 200 - POD 1 @ (F)	SK	Room 200 - POD 2 @ (A)	SK	Room 200 - POD 2 @ (B)	SK	Room 200 - POD 2 @ (C)	SK	Room 200 - POD 2 @ (D)	SK	Room 200 - POD 2 @ (E)	SK	Room 200 - POD 2 @ (F)	SK	Room 200 - POD 3 @ (A)	SK	Room 200 - POD 3 @ (B)	SK	Room 200 - POD 3 @ (C)	SK	Room 200 - POD 3 @ (D)	SK	Room 200 - POD 3 @ (E)	SK	Room 200 - POD 3 @ (F)	SK
LOCATION	SOURCE																																																																																									
Room 200 - Teacher Station	SK																																																																																									
Room 200 - Counter 1 @ (A)	SK																																																																																									
Room 200 - Counter 1 @ (B)	SK																																																																																									
Room 200 - Counter 2 @ (A)	SK																																																																																									
Room 200 - Counter 2 @ (B)	SK																																																																																									
Room 200 - Counter 3 @ (A)	SK																																																																																									
Room 200 - Counter 3 @ (B)	SK																																																																																									
LOCATION	SOURCE																																																																																									
Room 200 - Teacher Station	SK																																																																																									
Room 200 - Table 1 @ (A)	SK																																																																																									
Room 200 - Table 1 @ (B)	SK																																																																																									
Room 200 - Table 2 @ (A)	SK																																																																																									
Room 200 - Table 2 @ (B)	SK																																																																																									
Room 200 - Table 3 @ (A)	SK																																																																																									
Room 200 - Table 3 @ (B)	SK																																																																																									
Room 200 - Table 4 @ (A)	SK																																																																																									
Room 200 - Table 4 @ (B)	SK																																																																																									
Room 200 - Counter 1 @ (A)	SK																																																																																									
Room 200 - Counter 1 @ (B)	SK																																																																																									
Room 200 - Counter 2 @ (A)	SK																																																																																									
Room 200 - Counter 2 @ (B)	SK																																																																																									
Room 200 - Counter 3 @ (A)	SK																																																																																									
Room 200 - Counter 3 @ (B)	SK																																																																																									
LOCATION	SOURCE																																																																																									
Room 200 - Teacher Station	SK																																																																																									
Room 200 - POD 1 @ (A)	SK																																																																																									
Room 200 - POD 1 @ (B)	SK																																																																																									
Room 200 - POD 1 @ (C)	SK																																																																																									
Room 200 - POD 1 @ (D)	SK																																																																																									
Room 200 - POD 1 @ (E)	SK																																																																																									
Room 200 - POD 1 @ (F)	SK																																																																																									
Room 200 - POD 2 @ (A)	SK																																																																																									
Room 200 - POD 2 @ (B)	SK																																																																																									
Room 200 - POD 2 @ (C)	SK																																																																																									
Room 200 - POD 2 @ (D)	SK																																																																																									
Room 200 - POD 2 @ (E)	SK																																																																																									
Room 200 - POD 2 @ (F)	SK																																																																																									
Room 200 - POD 3 @ (A)	SK																																																																																									
Room 200 - POD 3 @ (B)	SK																																																																																									
Room 200 - POD 3 @ (C)	SK																																																																																									
Room 200 - POD 3 @ (D)	SK																																																																																									
Room 200 - POD 3 @ (E)	SK																																																																																									
Room 200 - POD 3 @ (F)	SK																																																																																									
<div>ENVIROSCIENCE CONSULTANTS, INC. 2150 SMITH TOWN AVENUE RONKONKOMA, NY 11779 (631) 580-3191 FAX 580-3195 www.envirohealth.org</div>	<div>WATER SAMPLING METHODOLOGY</div>	<div>KEY PLAN NO SCALE</div>	<div>NOT TO SCALE Date: 9/26/2016 By: Robert Castana DRAWING 2 of 2</div>																																																																																							

3.0 Initial Results

All water source locations in each of the school buildings were assessed. Water source locations identified as drinking water sources were considered Applicable, and first draw samples were collected. Water source locations identified as non-drinking water sources were considered non-applicable and these locations were documented.

The results of the initial sampling and the use of signs warning against water use at non-applicable sources is documented in the School Water Outlet Inventory for each building.

All elevated locations should be taken off line until the remediation is completed. Any other drinking water sources in these buildings that were not functional at the time of initial sampling and have not been tested should be tested before returning to service. All locations deemed non-applicable, but do not have signs, should be taken offline until signs have been posted. Signs are suggested to have pictures that instruct for handwashing only, do not drink.

The following is a summary of results in parts per billion (ppb) of locations in the Huntington UFSD where sample results were found above 5 ppb:

Flower Hill Primary School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Kitchen Prep Sink - Left	6.0	1/31/2025	Removed from Service; Pending Remediation
Room 16 Sink	6.0	1/31/2025	Removed from Service; Pending Remediation
Room 22 Water Fountain	16.0	1/31/2025	Removed from Service; Pending Remediation
Room 21 Water Fountain	24.0	1/31/2025	Removed from Service; Pending Remediation
Room 2 Water Fountain	23.0	1/31/2025	Removed from Service; Pending Remediation
Room 13 Water Fountain	10.0	1/31/2025	Removed from Service; Pending Remediation

Jefferson Primary School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Room 14 Water Fountain	8.0	1/31/2025	Removed from Service; Pending Remediation
Room 14 Bathroom Sink	9.0	1/31/2025	Removed from Service; Pending Remediation
Room 17 Water Fountain	6.0	1/31/2025	Removed from Service; Pending Remediation
Room 19 Water Fountain	6.0	1/31/2025	Removed from Service; Pending Remediation
Room 21 Water Fountain	11.0	1/31/2025	Removed from Service; Pending Remediation
Room 20 Water Fountain	10.0	1/31/2025	Removed from Service; Pending Remediation
Room 23 Water Fountain	11.0	1/31/2025	Removed from Service; Pending Remediation
Room 22 Water Fountain	11.0	1/31/2025	Removed from Service; Pending Remediation
Room 24 Water Fountain	8.0	1/31/2025	Removed from Service; Pending Remediation
Hallway by Room 24 Water Fountain	10.0	1/31/2025	Removed from Service; Pending Remediation
Room 25 Water Fountain	6.0	1/31/2025	Removed from Service; Pending Remediation
Room 26 Water Fountain	6.0	1/31/2025	Removed from Service; Pending Remediation

Southdown Primary School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Room 17 Water Fountain	151.0	1/30/2025	Removed from Service; Pending Remediation
Room 18 Water Fountain	48.0	1/30/2025	Removed from Service; Pending Remediation
Room 22 Water Fountain	13.0	1/30/2025	Removed from Service; Pending Remediation
Room 1 Water Fountain	45.0	1/30/2025	Removed from Service; Pending Remediation
Room 2 Water Fountain	96.0	1/30/2025	Removed from Service; Pending Remediation

Washington Primary School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Kitchen Dishwash Station Sink	9.0	1/30/2025	Removed from Service; Pending Remediation
Kitchen Dishwash Station - 2 Bay – Left Sink	9.0	1/30/2025	Removed from Service; Pending Remediation
Room 18 Water Fountain	14.0	1/30/2025	Removed from Service; Pending Remediation
Room 1 Water Fountain	156.0	1/30/2025	Removed from Service; Pending Remediation
Room 2 Water Fountain	179.0	1/30/2025	Removed from Service; Pending Remediation
Room 13 Water Fountain	7.0	1/30/2025	Removed from Service; Pending Remediation

Jack Abrams STEM Magnet School

SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Kitchen Food Prep @A Sink	8.0	1/29/2025	Removed from Service; Pending Remediation
Kitchen New Prep Sink by Pot Shelf	8.0	1/29/2025	Removed from Service; Pending Remediation
Kitchen Potfiller North – Right Spigot	9.0	1/29/2025	Removed from Service; Pending Remediation
Kitchen Potfiller South – Left Spigot	6.0	1/29/2025	Removed from Service; Pending Remediation
Room 211 Water Fountain	30.0	1/29/2025	Removed from Service; Pending Remediation
Room 205 Water Fountain	21.0	1/29/2025	Removed from Service; Pending Remediation
Room 203 Water Fountain	24.0	1/29/2025	Removed from Service; Pending Remediation
Room 201 Water Fountain	7.0	1/29/2025	Removed from Service; Pending Remediation
Room 202 Water Fountain	37.0	1/29/2025	Removed from Service; Pending Remediation
STEM Director K-12 Room 202A Sink	25.0	1/29/2025	Removed from Service; Pending Remediation
Room 204 Water Fountain	6.0	1/29/2025	Removed from Service; Pending Remediation
Room 206 Water Fountain	13.0	1/29/2025	Removed from Service; Pending Remediation
Room 208 Water Fountain	20.0	1/29/2025	Removed from Service; Pending Remediation
Room 210 Water Fountain	13.0	1/29/2025	Removed from Service; Pending Remediation
Room 214 Water Fountain	13.0	1/29/2025	Removed from Service; Pending Remediation
Room 218 Water Fountain	10.0	1/29/2025	Removed from Service; Pending Remediation
Room 220 Water Fountain	13.0	1/29/2025	Removed from Service; Pending Remediation
Room 221 Water Fountain	10.0	1/29/2025	Removed from Service; Pending Remediation

Jack Abrams STEM Magnet School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Room 219 Water Fountain	15.0	1/29/2025	Removed from Service; Pending Remediation
Room 217 Water Fountain	14.0	1/29/2025	Removed from Service; Pending Remediation
Room 215 Water Fountain	20.0	1/29/2025	Removed from Service; Pending Remediation
Room 213 Water Fountain	14.0	1/29/2025	Removed from Service; Pending Remediation
Administration Breakroom Sink	14.0	1/29/2025	Removed from Service; Pending Remediation
Administration Breakroom Water Fountain	9.0	1/29/2025	Removed from Service; Pending Remediation
Transportation Sink	7.0	1/29/2025	Removed from Service; Pending Remediation
Human Resources Sink	6.0	1/29/2025	Removed from Service; Pending Remediation
Boys Locker Room Water Fountain	87.0	1/29/2025	Removed from Service; Pending Remediation

Woodhull Intermediate School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Room 5 Water Fountain	7.0	1/29/2025	Removed from Service; Pending Remediation
Room 7 Water Fountain	9.0	1/29/2025	Removed from Service; Pending Remediation
Room 8 Water Fountain	12.0	1/29/2025	Removed from Service; Pending Remediation
Room 11 Water Fountain	9.0	1/29/2025	Removed from Service; Pending Remediation
Room 21 Water Fountain	18.0	1/29/2025	Removed from Service; Pending Remediation
Room 18 Water Fountain	38.0	1/29/2025	Removed from Service; Pending Remediation

Woodhull Intermediate School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Room 15 Water Fountain	7.0	1/29/2025	Removed from Service; Pending Remediation
Hallway by Custodial Office Water Fountain	47.0	1/29/2025	Removed from Service; Pending Remediation

J. Taylor Finley School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Kitchen New Prep by Sanitizer Sink	8.0	1/28/2025	Removed from Service; Pending Remediation
Kitchen Pot Filler by Stove- Spigot	8.0	1/28/2025	Removed from Service; Pending Remediation
Hallway by Girls Coach's Office	8.0	1/28/2025	Removed from Service; Pending Remediation
Boys Locker Room Water Fountain	6.0	1/28/2025	Removed from Service; Pending Remediation
Hallway by Room 123 Water Fountain	8.0	1/28/2025	Removed from Service; Pending Remediation
Hallway by Room 112 Water Fountain	9.0	1/28/2025	Removed from Service; Pending Remediation
Room 208 Station 1 Sink	10.0	1/28/2025	Removed from Service; Pending Remediation
Room 208 Station 2 Sink	9.0	1/28/2025	Removed from Service; Pending Remediation
Room 208 Station 3 Sink	12.0	1/28/2025	Removed from Service; Pending Remediation
Room 208 Station 4 Sink	13.0	1/28/2025	Removed from Service; Pending Remediation
Hallway by Room 207 Water Fountain	7.0	1/28/2025	Removed from Service; Pending Remediation
Room 207 Station 2 Sink	9.0	1/28/2025	Removed from Service; Pending Remediation
Room 207 Station 3 Sink	19.0	1/28/2025	Removed from Service; Pending Remediation

J. Taylor Finley School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Room 207 Station 4 Sink	15.0	1/28/2025	Removed from Service; Pending Remediation

Huntington High School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Hallway by Custodial Entrance Water Fountain	7.0	1/28/2025	Removed from Service; Pending Remediation
Kitchen Prep @ A Sink	8.0	1/28/2025	Removed from Service; Pending Remediation
Kitchen Island Sink	7.0	1/28/2025	Removed from Service; Pending Remediation
Hallway by Room 103 Water Fountain	7.0	1/28/2025	Removed from Service; Pending Remediation
Hallway by Room 101 Water Fountain	14.0	1/28/2025	Removed from Service; Pending Remediation
Room 161 Sink	31.0	1/28/2025	Removed from Service; Pending Remediation
Nurse's Office Sink	6.0	1/28/2025	Removed from Service; Pending Remediation
Hallway by Room 110 Water Fountain	9.0	1/28/2025	Removed from Service; Pending Remediation
Hallway by Room 112 Water Fountain	21.0	1/28/2025	Removed from Service; Pending Remediation
Hallway by Cafeteria B Water Fountain	9.0	1/28/2025	Removed from Service; Pending Remediation
Hallway Ramp (East) Water Fountain	7.0	1/28/2025	Removed from Service; Pending Remediation
Hallway by Room 132 (Security Office) Water Fountain	31.0	1/28/2025	Removed from Service; Pending Remediation
Girl's Sports Locker Room Bathroom Water Fountain	12.0	1/28/2025	Removed from Service; Pending Remediation
Hallway by Room 228 Water Fountain	17.0	1/28/2025	Removed from Service; Pending Remediation

Huntington High School			
SAMPLE LOCATION	RESULT	SAMPLE DATE	REMARKS
Hallway by Room 241 Water Fountain	23.0	1/28/2025	Removed from Service; Pending Remediation
Hallway by Room 251 Water Fountain	14.0	1/28/2025	Removed from Service; Pending Remediation
Hallway by Room 208 Water Fountain	9.0	1/28/2025	Removed from Service; Pending Remediation
Hallway by Room 203 Water Fountain	8.0	1/28/2025	Removed from Service; Pending Remediation
Room 216A Sink	6.0	1/28/2025	Removed from Service; Pending Remediation

Appendix A

Flower Hill Primary School

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1000-1	Kitchen Prep Sink - Left	SK	App	3.0	2/27/2025	-	-	-	Remediation Complete
				6.0	1/31/2025				Removed from service; pending remediation
1000-1	Kitchen Dishwash @ A	SK	N/A		1/31/2025				Sign
1000-2	Kitchen Dishwash @ B	SK	N/A		1/31/2025				Sign
1000-3	Kitchen Dishwash @ C	SPY	N/A		1/31/2025				Sign
1000-4	Kitchen Handwash	SK	N/A		1/31/2025				Sign
1000-5	Kitchen Potfiller	PF	N/A		1/31/2025				Removed from Service
1001-1	Room 15 Bathroom	SK	N/A		1/31/2025				Sign
1002-1	Girl's Bathroom by Room 16 @ A	SK	N/A		1/31/2025				Sign
1002-2	Girl's Bathroom by Room 16 @ B	SK	N/A		1/31/2025				Sign
1002-3	Girl's Bathroom by Room 16 @ C	SK	N/A		1/31/2025				Sign
1003-1	Custodial Closet by Room 16	SS	N/A		1/31/2025				Sign
1004-1	Room 16	SK	App	2.0	2/27/2025				Remediation Complete
				6.0	1/31/2025				Removed from service; pending remediation
1004-2	Room 16	WF	App		1/31/2025				Non-functional; sampling required before returning to service
1005-1	Boy's Bathroom by Room 16 @ A	SK	N/A		1/31/2025				Sign
1005-2	Boy's Bathroom by Room 16 @ B	SK	N/A		1/31/2025				Sign
1005-3	Boy's Bathroom by Room 16 @ C	SK	N/A		1/31/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1006-1	Room 17	SK	N/A		1/31/2025				Sign
1006-2	Room 17	WF	App	2.0	1/31/2025				
1007-1	Hallway by Room 17	WF	App	<1.0	1/31/2025				
1007-1	Hallway by Room 17	BF	App	<1.0	1/31/2025				
1008-1	Room 18 (Art)	SK	N/A		1/31/2025				Sign
1009-1	Room 20	SK	N/A		1/31/2025				Sign
1009-2	Room 20	WF	App	5.0	1/31/2025				
1010-1	Room 21	SK	N/A		1/31/2025				Sign
1010-2	Room 21	WF	App	24.0	1/31/2025				Capped
1011-1	Room 22	SK	N/A		1/31/2025				Sign
1011-2	Room 22	WF	App	16.0	1/31/2025				Capped
1012-1	Hallway by Gym	BF	App	<1.0	1/31/2025				
1012-2	Hallway by Gym	WF	App	<1.0	1/31/2025				
1013-1	Custodial Closet by Kitchen	SS	N/A		1/31/2025				Sign
1014-1	Adult Bathroom by Gym	SK	N/A		1/31/2025				Sign
1015-1	Nurse's Bathroom	SK	N/A		1/31/2025				Sign
1016-1	Faculty Lounge	SK	App	1.0	1/31/2025				
1017-1	Women's Bathroom by Faculty Lounge @ A	SK	N/A		1/31/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1017-2	Women's Bathroom by Faculty Lounge @ B	SK	N/A		1/31/2025				Sign
1018-1	Hallway by Room 8	WF	App	1.0	1/31/2025				
1018-1	Hallway by Room 8	BF	App	1.0	1/31/2025				
1019-1	Room 7	SK	N/A		1/31/2025				Sign
1019-2	Room 7	WF	App	1.0	1/31/2025				
1019-3	Room 7 Bathroom	SK	N/A		1/31/2025				Sign
1020-1	Room 5	SK	N/A		1/31/2025				Sign
1020-2	Room 5	WF	App	<1.0	1/31/2025				
1020-3	Room 5 Bathroom	SK	N/A		1/31/2025				Sign
1021-1	Room 3	SK	N/A		1/31/2025				Sign
1021-2	Room 3	WF	App	3.0	1/31/2025				
1021-3	Room 3 Bathroom	SK	N/A		1/31/2025				Sign
1022-1	Room 1	SK	N/A		1/31/2025				Sign
1022-2	Room 1	WF	App		1/31/2025				Non-functional; sampling required before returning to service
1022-3	Room 1 Bathroom	SK	N/A		1/31/2025				Sign
1023-1	Room 2	SK	N/A		1/31/2025				Sign
1023-2	Room 2	WF	App	23.0	1/31/2025				Capped
1023-3	Room 2 Bathroom	SK	N/A		1/31/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1024-1	Room 4	SK	N/A		1/31/2025				Sign
1024-2	Room 4	WF	App		1/31/2025				Non-functional; sampling required before returning to service
1024-3	Room 4 Bathroom	SK	App	2.0	1/31/2025				
1025-1	Room 6	SK	N/A		1/31/2025				Sign
1025-2	Room 6	WF	App	3.0	1/31/2025				
1025-3	Room 6 Bathroom	SK	N/A		1/31/2025				Sign
1026-1	Room 8	SK	N/A		1/31/2025				Sign
1026-2	Room 8	WF	App	3.0	1/31/2025				
1026-3	Room 8 Bathroom	SK	N/A		1/31/2025				Sign
1027-1	Girl's Bathroom by Room 8 @ A	SK	N/A		1/31/2025				Sign
1027-2	Girl's Bathroom by Room 8 @ B	SK	N/A		1/31/2025				Sign
1028-1	Custodial Closet by Room 8	SS	N/A		1/31/2025				Sign
1029-1	Boy's Bathroom by Room 8 @ A	SK	N/A		1/31/2025				Sign
1029-2	Boy's Bathroom by Room 8 @ B	SK	N/A		1/31/2025				Sign
1030-1	Room 10	SK	N/A		1/31/2025				Sign
1030-2	Room 10	WF	App		1/31/2025				Non-functional; sampling required before returning to service
1031-1	Room 12	SK	N/A		1/31/2025				Sign
1031-2	Room 12	WF	App	3.0	1/31/2025				

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1032-1	Room 14	SK	N/A		1/31/2025				Sign
1032-2	Room 14	WF	App		1/31/2025				Non-functional; sampling required before returning to service
1033-1	Room 13	SK	N/A		1/31/2025				Sign
1033-2	Room 13	WF	App	10.0	1/31/2025				Capped
1034-1	Room 11	SK	N/A		1/31/2025				Sign
1034-2	Room 11	WF	App		1/31/2025				Non-functional; sampling required before returning to service
1035-1	Custodial Office Bathroom	SK	N/A		1/31/2025				Sign
1035-2	Custodial Office - Can Cleaner	SS	N/A		1/31/2025				Sign

Laboratory Report

NYE Report #: 2500419-32250

February 5, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington UFSD; Flower Hill Primary School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on February 03, 2025. New York Environmental analyzed the samples on February 04, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	31 Jan 2025
Date Received:	03 Feb 2025
Date Analyzed:	04 Feb 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250203N031	1	Kitchen Prep Sink - Left - SK , Initial	0.001	0.006	mg/L	H
250203N032	2	Room 16 - SK , Initial	0.001	0.006	mg/L	H
250203N033	3	Room 17 - WF , Initial	0.001	0.002	mg/L	
250203N034	4	Hallway by Room 17 - WF , Initial	0.001	<0.001	mg/L	
250203N035	5	Hallway by Room 17 - BF , Initial	0.001	<0.001	mg/L	
250203N036	6	Room 20 - WF , Initial	0.001	0.005	mg/L	
250203N037	7	Room 22 - WF , Initial	0.001	0.016	mg/L	H
250203N038	8	Room 21 - WF , Initial	0.001	0.024	mg/L	H
250203N039	9	Hallway by Gym - WF , Initial	0.001	<0.001	mg/L	
250203N040	10	Hallway by Gym - BF , Initial	0.001	<0.001	mg/L	
250203N041	11	Faculty Lounge - SK , Initial	0.001	0.001	mg/L	
250203N042	12	Hallway by Room 8 - WF , Initial	0.001	<0.001	mg/L	
250203N043	13	Hallway by Room 8 - BF , Initial	0.001	<0.001	mg/L	
250203N044	14	Room 7 - WF , Initial	0.001	0.001	mg/L	
250203N045	15	Room 5 - WF , Initial	0.001	<0.001	mg/L	
250203N046	16	Room 3 - WF , Initial	0.001	0.003	mg/L	
250203N047	17	Room 2 - WF , Initial	0.001	0.023	mg/L	H
250203N048	18	Room 4 Bathroom - SK , Initial	0.001	0.002	mg/L	
250203N049	19	Room 6 - WF , Initial	0.001	0.003	mg/L	
250203N050	20	Room 8 - WF , Initial	0.001	0.003	mg/L	
250203N051	21	Room 12 - WF , Initial	0.001	0.003	mg/L	
250203N052	22	Room 13 - WF , Initial	0.001	0.010	mg/L	H

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.



Laboratory Report

NYE Report #: 2500754-32495

March 3, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington UFSD; Flower Hill Primary School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on February 28, 2025. New York Environmental analyzed the samples on March 03, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	27 Feb 2025
Date Received:	28 Feb 2025
Date Analyzed:	03 Mar 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250228K010	1A	Kitchen Prep Sink - Left - SK, Initial	0.001	0.003	mg/L	
250228K011	1B	Kitchen Prep Sink - Left - SK, 15 Second Flush	0.001	NA	mg/L	
250228K012	1C	Kitchen Prep Sink - Left - SK, 60 Second Flush	0.001	NA	mg/L	
250228K013	2A	Room 16 - SK, Initial	0.001	0.002	mg/L	
250228K014	2B	Room 16 - SK, 15 Second Flush	0.001	NA	mg/L	
250228K015	2C	Room 16 - SK, 60 Second Flush	0.001	NA	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

NA: Sample not analyzed per customer request.

Appendix B

Jefferson Primary School

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1000-1	Kitchen Island	SK	App	4.0	1/31/2025				
1000-2	Kitchen Handwash	SK	N/A		1/31/2025				Sign
1000-3	Kitchen Dishwash	SK	N/A		1/31/2025				Sign
1000-4	Kitchen Dishwash	SPY	N/A		1/31/2025				Sign
1000-5	Kitchen Bathroom	SK	N/A		1/31/2025				Sign
1001-1	Gym Vestibule	BF	App	<0.1	1/31/2025				
1001-2	Gym Vestibule	WF	App	<0.1	1/31/2025				
1002-1	Hallway by Cafeteria	WF	App	1.0	1/31/2025				
1003-1	Adult Bathroom	SK	N/A		1/31/2025				Sign
1004-1	Nurse's Office	SK	App	2.0	1/31/2025				
1004-2	Nurse's Office Bathroom	SK	N/A		1/31/2025				Sign
1005-1	Hallway by Room 9	BF	App	<0.1	1/31/2025				
1005-1	Hallway by Room 9	WF	App	<0.1	1/31/2025				
1006-1	Room 9	SK	N/A		1/31/2025				Sign
1007-1	Room 7	SK	N/A		1/31/2025				Sign
1007-2	Room 7	WF	App		1/31/2025				Non-functional; sampling required before returning to service
1008-1	Room 5	SK	N/A		1/31/2025				Sign
1008-2	Room 5	WF	App		1/31/2025				Non-functional; sampling required before returning to service

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1009-1	Room 3	SK	N/A		1/31/2025				Sign
1009-2	Room 3	WF	App	1.0	1/31/2025				
1010-1	Room 1	SK	N/A		1/31/2025				Sign
1010-2	Room 1	WF	App	4.0	1/31/2025				
1011-1	Room 2	SK	N/A		1/31/2025				Sign
1011-2	Room 2	WF	App	4.0	1/31/2025				
1012-1	Room 4	SK	N/A		1/31/2025				Sign
1012-2	Room 4	WF	App	1.0	1/31/2025				
1013-1	Room 6	SK	N/A		1/31/2025				Sign
1013-2	Room 6	WF	App	3.0	1/31/2025				
1014-1	Room 8	SK	N/A		1/31/2025				Sign
1014-2	Room 8	WF	App		1/31/2025				Non-functional; sampling required before returning to service
1015-1	Men's Bathroom by Room 8	SK	N/A		1/31/2025				Sign
1017-1	Women's Bathroom by Room 9	SK	N/A		1/31/2025				Sign
1018-1	Room 11 Faculty Room	SK	App	<1.0	1/31/2025				
1019-1	Room 12 Bathroom	SK	App	4.0	1/31/2025				
1020-1	Room 14	SK	N/A		1/31/2025				Sign
1020-2	Room 14	WF	App	8.0	1/31/2025				Capped

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1020-3	Room 14 Bathroom	SK	App	22.0	2/27/2025	<1.0	<1.0		Removed from service; pending fixture replacement
				9.0	1/31/2025				Removed from service; pending remediation
	Hall by Library	BF	App	<1.0	1/31/2025				
	Hall by Library	WF	App	<1.0	1/31/2025				
1021-1	Library Office	SK	N/A		1/31/2025				Sign
1021-2	Library	SK	N/A		1/31/2025				Sign
1022-1	Room 17	SK	N/A		1/31/2025				Sign
1022-2	Room 17	WF	App	6.0	1/31/2025				Capped
1023-1	Room 19	SK	N/A		1/31/2025				Sign
1023-2	Room 19	WF	App	6.0	1/31/2025				Capped
1024-1	Room 18	SK	N/A		1/31/2025				Sign
1024-2	Room 18	WF	App	3.0	1/31/2025				
1025-1	Room 21	SK	N/A		1/31/2025				Sign
1025-2	Room 21	WF	App	11.0	1/31/2025				Capped
1026-1	Room 20	SK	N/A		1/31/2025				Sign
1026-2	Room 20	WF	App	10.0	1/31/2025				Capped
1027-1	Room 23	SK	N/A		1/31/2025				Sign
1027-2	Room 23	WF	App	11.0	1/31/2025				Capped

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1028-1	Room 22	SK	N/A		1/31/2025				Sign
1028-2	Room 22	WF	App	11.0	1/31/2025				Capped
1029-1	Room 24	SK	N/A		1/31/2025				Sign
1029-2	Room 24	WF	App	8.0	1/31/2025				Capped
1030-1	Boy's Bathroom by Room 24 @ A	SK	N/A		1/31/2025				Sign
1030-2	Boy's Bathroom by Room 24 @ B	SK	N/A		1/31/2025				Sign
1030-3	Boy's Bathroom by Room 24 @ C	SK	N/A		1/31/2025				Sign
1030-4	Boy's Bathroom by Room 24 @ D	SK	N/A		1/31/2025				Sign
1030-5	Boy's Bathroom by Room 24 @ E	SK	N/A		1/31/2025				Sign
1031-1	Women's Bathroom by Room 24	SK	N/A		1/31/2025				Sign
1031-2	Hall by Room 24	WF	App	13.0	2/27/2025	2.0	1.0	2/27/2025	Removed from service; pending fixture replacement
				10.0					Removed from service; pending remediation
1032-1	Girl's Bathroom by Room 25 @ A	SK	N/A		1/31/2025				Sign
1032-2	Girl's Bathroom by Room 25 @ B	SK	N/A		1/31/2025				Sign
1032-3	Room 25	SK	N/A		1/31/2025				Sign
1033-1	Room 25	WF	App	6.0	1/31/2025				Capped
1034-1	Room 26	WF	App	6.0	1/31/2025				Capped
1034-2	Room 27	WF	App	3.0	1/31/2025				

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1035-1	Room 27 Art Room	SK	N/A		1/31/2025				Sign
1035-2	Room 27 Art Room	SK	N/A		1/31/2025				Sign
1035-3	Room 27 Art Room	SK	N/A		1/31/2025				Sign
1035-4	Room 27 Art Room	SK	N/A		1/31/2025				Sign
1036-1	Custodial Closet by Kitchen	SK	N/A		1/31/2025				Sign
1037-1	Physical Education Office	SK	N/A		1/31/2025				Sign
1038-1	Custodial Office Bathroom	SK	N/A		1/31/2025				Sign
1039-1	Custodial Closet by Room 2	SK	N/A		1/31/2025				Sign

Laboratory Report

NYE Report #: 2500418-32249

February 5, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington UFSD; Jefferson Primary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on February 03, 2025. New York Environmental analyzed the samples on February 04, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	31 Jan 2025
Date Received:	03 Feb 2025
Date Analyzed:	04 Feb 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250203N001	1	Kitchen Island-SK, Initial	0.001	0.004	mg/L	
250203N002	2	Gym Vestibule-BF, Initial	0.001	<0.001	mg/L	
250203N003	3	Gym Vestibule-WF, Initial	0.001	<0.001	mg/L	
250203N004	4	Hallway by Cafeteria-WF, Initial	0.001	0.001	mg/L	
250203N005	5	Nurse's Office-SK, Initial	0.001	0.002	mg/L	
250203N006	6	Hallway by Room 9-BF, Initial	0.001	<0.001	mg/L	
250203N007	7	Hallway by Room 9-WF, Initial	0.001	<0.001	mg/L	
250203N008	8	Room 3-WF, Initial	0.001	0.001	mg/L	
250203N009	9	Room 1-WF, Initial	0.001	0.004	mg/L	
250203N010	10	Room 2-WF, Initial	0.001	0.004	mg/L	
250203N011	11	Room 4-WF, Initial	0.001	0.001	mg/L	
250203N012	12	Room 6-WF, Initial	0.001	0.003	mg/L	
250203N013	13	Room 11 Faculty Room-SK, Initial	0.001	<0.001	mg/L	
250203N014	14	Room 12 Bathroom-SK, Initial	0.001	0.004	mg/L	
250203N015	15	Room 14-WF, Initial	0.001	0.008	mg/L	H
250203N016	16	Room 14 Bathroom-SK, Initial	0.001	0.009	mg/L	H
250203N017	17	Room 17-WF, Initial	0.001	0.006	mg/L	H
250203N018	18	Room 19-WF, Initial	0.001	0.006	mg/L	H
250203N019	19	Room 18-WF, Initial	0.001	0.003	mg/L	
250203N020	20	Room 21-WF, Initial	0.001	0.011	mg/L	H
250203N021	21	Room 20-WF, Initial	0.001	0.010	mg/L	H
250203N022	22	Room 23-WF, Initial	0.001	0.011	mg/L	H
250203N023	23	Room 22-WF, Initial	0.001	0.011	mg/L	H
250203N024	24	Room 24-WF, Initial	0.001	0.008	mg/L	H
250203N025	25	Hall by Room 24-WF, Initial	0.001	0.010	mg/L	H
250203N026	26	Hall by Library-BF, Initial	0.001	<0.001	mg/L	



Date Collected:	31 Jan 2025
Date Received:	03 Feb 2025
Date Analyzed:	04 Feb 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250203N027	27	Hall by Library-WF, Initial	0.001	<0.001	mg/L	
250203N028	28	Room 25-WF, Initial	0.001	0.006	mg/L	H
250203N029	29	Room 26-WF, Initial	0.001	0.006	mg/L	H
250203N030	30	Room 27-WF, Initial	0.001	0.003	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

Laboratory Report

NYE Report #: 2500756-32497

March 3, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington UFSD; Jefferson Primary School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on February 28, 2025. New York Environmental analyzed the samples on March 03, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	27 Feb 2025
Date Received:	28 Feb 2025
Date Analyzed:	03 Mar 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250228K040	1A	Room 14 Bathroom - SK, Initial	0.001	0.022	mg/L	H
250228K041	1B	Room 14 Bathroom - SK, 15 Second Flush	0.001	<0.001	mg/L	
250228K042	1C	Room 14 Bathroom - SK, 60 Second Flush	0.001	<0.001	mg/L	
250228K043	2A	Hallway by Room 24 - WF, Initial	0.001	0.013	mg/L	H
250228K044	2B	Hallway by Room 24 - WF, 15 Second Flush	0.001	0.002	mg/L	
250228K045	2C	Hallway by Room 24 - WF, 60 Second Flush	0.001	0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

Appendix C

Southdown Primary School

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1001-1	Kitchen Handwash	SK	N/A		1/30/2025				Sign
1001-2	Kitchen Dishwash Station @ A	SK	N/A		1/30/2025				Sign
1001-3	Kitchen Dishwash Station @ B	SK	N/A		1/30/2025				Sign
1001-4	Kitchen Dishwasher Spray	SPY	N/A		1/30/2025				Sign
1001-5	Kitchen Dishwasher Station Prep	SK	App	5.0	1/30/2025				
1002-1	Room 15 Bathroom	SK	N/A		1/30/2025				Sign
1003-1	Room 16	SK	N/A		1/30/2025				Sign
1003-2	Room 16	WF	App		1/30/2025				Non-functional; sampling required before returning to service
1004-1	Room 17	SK	N/A		1/30/2025				Sign
1004-2	Room 17	WF	App	151.0	1/30/2025				Capped
1005-1	Room 18	SK	N/A		1/30/2025				Sign
1005-2	Room 18	WF	App	48.0	1/30/2025				Capped
1006-1	Room 19	SK	N/A		1/30/2025				Sign
1006-2	Room 19	WF	App	4.0	1/30/2025				
1007-1	Room 21	SK	N/A		1/30/2025				Sign
1007-2	Room 21	WF	App		1/30/2025				Non-functional; sampling required before returning to service
1008-1	Room 22	SK	N/A		1/30/2025				Sign
1008-2	Room 22	WF	App	13.0	1/30/2025				Capped

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1009-1	Hallway By Room 17	WF	App	<1.0	1/30/2025				
1009-1	Hallway By Room 17	BF	App	<1.0	1/30/2025				
1010-2	Boys Bathroom by Room 16 @ B	SK	N/A		1/30/2025				Sign
1010-3	Boys Bathroom by Room 16 @ C	SK	N/A		1/30/2025				Sign
1011-1	Girls Bathroom by Room 16 @ A	SK	N/A		1/30/2025				Sign
1011-2	Girls Bathroom by Room 16 @ B	SK	N/A		1/30/2025				Sign
1011-3	Girls Bathroom by Room 16 @ C	SK	N/A		1/30/2025				Sign
1012-1	Custodial Closet by Room 16	SS	N/A		1/30/2025				Sign
1013-1	Hallway by Cafeteria	WF	App	<1.0	1/30/2025				
1013-2	Hallway by Cafeteria	BF	App	<1.0	1/30/2025				
1014-1	Custodial Office Bathroom	SK	N/A		1/30/2025				Sign
1015-1	Mens Faculty Bathroom by Gym	SK	N/A		1/30/2025				Sign
1017-1	Faculty Lounge	SK	App	1.0	1/30/2025				
1017-2	Faculty Lounge	WF	App		1/30/2025				Non-functional; sampling required before returning to service
1018-1	Womens Faculty Bathroom @ A	SK	N/A		1/30/2025				Sign
1018-2	Womens Faculty Bathroom @ B	SK	N/A		1/30/2025				Sign
1019-1	Hallway by Room 7	BF	App	<1.0	1/30/2025				
1019-1	Hallway by Room 7	WF	App	<1.0	1/30/2025				

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1020-1	Room 8	SK	N/A		1/30/2025				Sign
1020-2	Room 8	WF	App		1/30/2025				Non-functional; sampling required before returning to service
1020-3	Room 8 Bathroom	SK	N/A		1/30/2025				Sign
1021-1	Room 10	SK	N/A		1/30/2025				Sign
1021-2	Room 10	WF	App	3.0	1/30/2025				
1021-3	Room 10 Bathroom	SK	N/A		1/30/2025				Sign
1022-1	Room 12	SK	N/A		1/30/2025				Sign
1022-2	Room 12	WF	App	4.0	1/30/2025				
1023-1	Room 14	SK	N/A		1/30/2025				Sign
1023-2	Room 14	WF	App	5.0	1/30/2025				
1024-1	Room 13	SK	N/A		1/30/2025				Sign
1024-2	Room 13	WF	App		1/30/2025				Non-functional; sampling required before returning to service
1025-1	Room 11	SK	N/A		1/30/2025				Sign
1025-2	Room 11	WF	App	3.0	1/30/2025				
1026-1	Room 9	SK	N/A		1/30/2025				Sign
1026-2	Room 9	WF	App	5.0	1/30/2025				
1027-1	Room 7	SK	N/A		1/30/2025				Sign
1027-2	Room 7	WF	App	3.0	1/30/2025				

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1027-3	Room 7 Bathroom	SK	N/A		1/30/2025				Sign
1028-1	Girls Bathroom by Room 7 @ A	SK	N/A		1/30/2025				Sign
1028-2	Girls Bathroom by Room 7 @ B	SK	N/A		1/30/2025				Sign
1029-1	Boys Bathroom by Room 7 @ A	SK	N/A		1/30/2025				Sign
1029-2	Boys Bathroom by Room 7 @ B	SK	N/A		1/30/2025				Sign
1030-1	Custodial Closet by Room 7	SS	N/A		1/30/2025				Sign
1031-1	Room 5	SK	N/A		1/30/2025				Sign
1031-2	Room 5	WF	App		1/30/2025				Non-functional; sampling required before returning to service
1031-3	Room 5 Bathroom	SK	N/A		1/30/2025				Sign
1032-1	Room 3	SK	N/A		1/30/2025				Sign
1032-2	Room 3	WF	App	3.0	1/30/2025				
1033-1	Room 1	SK	N/A		1/30/2025				Sign
1033-2	Room 1	WF	App	45.0	1/30/2025				Capped
1033-3	Room 1 Bathroom	SK	N/A		1/30/2025				Sign
1034-1	Room 2 Bathroom	SK	N/A		1/30/2025				Sign
1034-2	Room 2	WF	App	96.0	1/30/2025				Capped
1034-3	Room 2	SK	N/A		1/30/2025				Sign
1035-1	Room 4	SK	N/A		1/30/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1035-2	Room 4	WF	App		1/30/2025				Non-functional; sampling required before returning to service
1035-3	Room 4 Bathroom	SK	N/A		1/30/2025				Sign

Laboratory Report

NYE Report #: 2500385-32238

January 31, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington UFSD; Southdown School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on January 30, 2025. New York Environmental analyzed the samples on January 31, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	30 Jan 2025
Date Received:	30 Jan 2025
Date Analyzed:	31 Jan 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250130Q030	1	Kitchen Dishwasher Station Prep-SK, Initial	0.001	0.004	mg/L	
250130Q031	2	Room 17-WF, Initial	0.001	0.151	mg/L	E,H
250130Q032	3	Room 18-WF, Initial	0.001	0.048	mg/L	H
250130Q033	4	Room 19-WF, Initial	0.001	0.004	mg/L	
250130Q034	5	Room 22-WF, Initial	0.001	0.013	mg/L	H
250130Q035	6	Hallway by Room 17-WF, Initial	0.001	<0.001	mg/L	
250130Q036	7	Hallway by Room 17-BF, Initial	0.001	<0.001	mg/L	
250130Q037	8	Hallway by Cafeteria-WF, Initial	0.001	<0.001	mg/L	
250130Q038	9	Hallway by Cafeteria-BF, Initial	0.001	<0.001	mg/L	
250130Q039	10	Faculty Lounge-SK, Initial	0.001	0.001	mg/L	
250130Q040	11	Hallway by Room 7-BF, Initial	0.001	<0.001	mg/L	
250130Q041	12	Hallway by Room 7-WF, Initial	0.001	<0.001	mg/L	
250130Q042	13	Room 10-WF, Initial	0.001	0.003	mg/L	
250130Q043	14	Room 12-WF, Initial	0.001	0.004	mg/L	
250130Q044	15	Room 14-WF, Initial	0.001	0.005	mg/L	
250130Q045	16	Room 11-WF, Initial	0.001	0.003	mg/L	
250130Q046	17	Room 9-WF, Initial	0.001	0.005	mg/L	
250130Q047	18	Room 7-WF, Initial	0.001	0.003	mg/L	
250130Q048	19	Room 3-WF, Initial	0.001	0.003	mg/L	
250130Q049	20	Room 1-WF, Initial	0.001	0.045	mg/L	H
250130Q050	21	Room 2-WF, Initial	0.001	0.096	mg/L	E,H

Comment:

CID: Client ID LOQ: Limit of Quantitation

E: Sample result exceeds instrument calibration, value is estimated.

H: Sample result exceeds applicable regulatory limit.



Appendix D

Washington Primary School

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
0	1001-1	Kitchen Dishwash Station	SK	App	9.0	2/27/2025	<1.0	<1.0	2/27/2025	Removed from service; pending fixture replacement
					9.0	1/30/2025				Removed from service; pending remediation
	1001-2	Kitchen Dishwash Station - 2 Bay - Left	SK	App	12.0	2/27/2025	<1.0	<1.0	2/27/2025	Removed from service; pending fixture replacement
0					9.0	1/30/2025				Removed from service; pending remediation
0	1001-3	Kitchen Dishwash Station - 2 Bay - Right	SK	App	3.0	1/30/2025				
0	1001-4	Kitchen Handwash	SK	N/A		1/30/2025				Sign
0	1002-1	Room 15 Bathroom	SK	N/A		1/30/2025				Sign
0	1003-1	Girls Bathroom by Room 16 @ A	SK	N/A		1/30/2025				Sign
0	1003-2	Girls Bathroom by Room 16 @ B	SK	N/A		1/30/2025				Sign
0	1003-3	Girls Bathroom by Room 16 @ C	SK	N/A		1/30/2025				Sign
0	1004-1	Custodian Closet 3	SK	N/A		1/30/2025				Sign
0	1005-1	Room 16	SK	N/A		1/30/2025				Sign
0	1005-2	Room 16	WF	App		1/30/2025				Non-functional; sampling required before returning to service
0	1006-1	Boys Bathroom by Room 16 @ A	SK	N/A		1/30/2025				Sign
0	1006-2	Boys Bathroom by Room 16 @ B	SK	N/A		1/30/2025				Sign
0	1006-3	Boys Bathroom by Room 16 @ C	SK	N/A		1/30/2025				Sign
0	1007-1	Hallway by Room 17	BF	App	<1.0	1/30/2025				
0	1007-1	Hallway by Room 17	WF	App	<1.0	1/30/2025				
0	1008-1	Room 17	SK	N/A		1/30/2025				Sign
0	1008-2	Room 17	WF	App		1/30/2025				Non-functional; sampling required before returning to service

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
0	1009-1	Room 18	SK	N/A		1/30/2025				Sign
0	1009-2	Room 18	WF	App	14.0	1/30/2025				Capped
0	1010-1	Room 19	SK	N/A		1/30/2025				Sign
0	1010-2	Room 19	WF	App	5.0	1/30/2025				
0	1011-1	Room 22	SK	N/A		1/30/2025				Sign
0	1011-2	Room 22	WF	App	2.0	1/30/2025				
0	1012-1	Room 21	SK	N/A		1/30/2025				Sign
0	1012-2	Room 21	WF	App	<1.0	1/30/2025				
0	1013-1	Hallway by Cafeteria	BF	App	<1.0	1/30/2025				
0	1013-1	Hallway by Cafeteria	WF	App	<1.0	1/30/2025				
0	1014-1	Faculty Bathroom by Custodian Office	SK	N/A		1/30/2025				Sign
0	1015-1	Custodian Office Bathroom	SK	App		1/30/2025				Sign
0	1016-1	Nurse's Office Bathroom	SK	N/A		1/30/2025				Sign
0	1017-1	Faculty Lounge	SK	App	2.0	1/30/2025				
0	1018-2	Women Faculty Bathroom @ B	SK	N/A		1/30/2025				Sign
0	1019-1	Hallway by Room 8	BF	App	<1.0	1/30/2025				
0	1019-1	Hallway by Room 8	WF	App	<1.0	1/30/2025				
0	1020-1	Room 7	SK	N/A		1/30/2025				Sign
0	1020-2	Room 7	WF	App	<1.0	1/30/2025				
0	1020-3	Room 7 Bathroom	SK	N/A		1/30/2025				Sign

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
0	1021-1	Room 5	SK	N/A		1/30/2025				Sign
0	1021-2	Room 5	WF	App	<1.0	1/30/2025				
0	1021-3	Room 5 Bathroom	SK	N/A		1/30/2025				Sign
0	1022-1	Room 3	SK	N/A		1/30/2025				Sign
0	1022-2	Room 3	WF	App	2.0	1/30/2025				
0	1022-3	Room 3 Bathroom	SK	N/A		1/30/2025				Sign
0	1023-1	Room 1	SK	N/A		1/30/2025				Sign
0	1023-2	Room 1	WF	App	156.0	1/30/2025				Capped
0	1023-3	Room 1 Bathroom	SK	N/A		1/30/2025				Sign
0	1024-1	Room 2 Bathroom	SK	N/A		1/30/2025				Sign
0	1024-2	Room 2	WF	App	179.0	1/30/2025				Capped
0	1024-3	Room 2	SK	N/A		1/30/2025				Sign
0	1025-1	Room 4	SK	N/A		1/30/2025				Sign
0	1025-2	Room 4	WF	App	4.0	1/30/2025				
0	1025-3	Room 4 Bathroom	SK	N/A		1/30/2025				Sign
0	1026-1	Room 6	SK	N/A		1/30/2025				Sign
0	1026-2	Room 6	WF	App		1/30/2025				Non-functional; sampling required before returning to service
0	1026-3	Room 6 Bathroom	SK	N/A		1/30/2025				Sign
0	1027-1	Room 8	SK	N/A		1/30/2025				Sign
0	1027-2	Room 8	WF	App	<1.0	1/30/2025				

AHERA Space #	Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
0	1027-3	Room 8 Bathroom	SK	N/A		1/30/2025				Sign
0	1028-1	Girls Bathroom by Room 8 @ A	SK	N/A		1/30/2025				Sign
0	1028-2	Girls Bathroom by Room 8 @ B	SK	N/A		1/30/2025				Sign
0	1029-1	Custodian Closet by Room 8	SK	N/A		1/30/2025				Sign
0	1030-1	Boys Bathroom by Room 8 @ A	SK	N/A		1/30/2025				Sign
0	1030-2	Boys Bathroom by Room 8 @ B	SK	N/A		1/30/2025				Sign
0	1031-1	Room 10	SK	N/A		1/30/2025				Sign
0	1031-2	Room 10	WF	App	1.0	1/30/2025				
0	1032-1	Room 12	SK	N/A		1/30/2025				Sign
0	1032-1	Room 12	WF	App	<1.0	1/30/2025				
0	1033-1	Room 14	SK	N/A		1/30/2025				Sign
0	1033-2	Room 14	WF	App	<1.0	1/30/2025				
0	1034-1	Room 13	SK	N/A		1/30/2025				Sign
0	1034-2	Room 13	WF	App	7.0	1/30/2025				Capped
0	1035-1	Room 11	SK	N/A		1/30/2025				Sign
0	1035-2	Room 11	WF	App	2.0	1/30/2025				

Laboratory Report

NYE Report #: 2500384-32237

January 31, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington UFSD; Washington Primary School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on January 30, 2025. New York Environmental analyzed the samples on January 31, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	30 Jan 2025
Date Received:	30 Jan 2025
Date Analyzed:	31 Jan 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250130Q004	1	Kitchen Dishwash Station-SK, Initial	0.001	0.009	mg/L	H
250130Q005	2	Kitchen Dishwash Station - 2 Bay - Left-SK, Initial	0.001	0.009	mg/L	H
250130Q006	3	Kitchen Dishwash Station - 2 Bay - Right-SK, Initial	0.001	0.003	mg/L	
250130Q007	4	Hallway by Room 17-BF, Initial	0.001	<0.001	mg/L	
250130Q008	5	Hallway by Room 17-WF, Initial	0.001	<0.001	mg/L	
250130Q009	6	Room 18-WF, Initial	0.001	0.014	mg/L	H
250130Q010	7	Room 19-WF, Initial	0.001	0.005	mg/L	
250130Q011	8	Room 22-WF, Initial	0.001	0.002	mg/L	
250130Q012	9	Room 21-WF, Initial	0.001	<0.001	mg/L	
250130Q013	10	Hallway by Cafeteria-BF, Initial	0.001	<0.001	mg/L	
250130Q014	11	Hallway by Cafeteria-WF, Initial	0.001	<0.001	mg/L	
250130Q015	12	Faculty Lounge-SK, Initial	0.001	0.002	mg/L	
250130Q016	13	Hallway by Room 8-BF, Initial	0.001	<0.001	mg/L	
250130Q017	14	Hallway by Room 8-WF, Initial	0.001	<0.001	mg/L	
250130Q018	15	Room 7-WF, Initial	0.001	<0.001	mg/L	
250130Q019	16	Room 5-WF, Initial	0.001	<0.001	mg/L	
250130Q020	17	Room 3-WF, Initial	0.001	0.002	mg/L	
250130Q021	18	Room 1-WF, Initial	0.001	0.156	mg/L	E,H
250130Q022	19	Room 2-WF, Initial	0.001	0.179	mg/L	E,H
250130Q023	20	Room 4-WF, Initial	0.001	0.004	mg/L	
250130Q024	21	Room 8-WF, Initial	0.001	<0.001	mg/L	
250130Q025	22	Room 10-WF, Initial	0.001	0.001	mg/L	
250130Q026	23	Room 12-WF, Initial	0.001	<0.001	mg/L	
250130Q027	24	Room 14-WF, Initial	0.001	<0.001	mg/L	
250130Q028	25	Room 13-WF, Initial	0.001	0.007	mg/L	H
250130Q029	26	Room 11-WF, Initial	0.001	0.002	mg/L	

Date Collected:	30 Jan 2025
Date Received:	30 Jan 2025
Date Analyzed:	31 Jan 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
--------	-----	-----------------------------	-----	--------	-------	------

Comment:

CID: Client ID LOQ: Limit of Quantitation

E: Sample result exceeds instrument calibration, value is estimated.

H: Sample result exceeds applicable regulatory limit.

Laboratory Report

NYE Report #: 2500750-32491

March 3, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington UFSD; Washington Primary School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on February 28, 2025. New York Environmental analyzed the samples on March 03, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	27 Feb 2025
Date Received:	28 Feb 2025
Date Analyzed:	03 Mar 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250228J001	1A	Kitchen Dishwash Station - 2 Bay - Left - SK, Initial	0.001	0.012	mg/L	H
250228J002	1B	Kitchen Dishwash Station - 2 Bay - Left - SK, 15 Second Flush	0.001	<0.001	mg/L	
250228J003	1C	Kitchen Dishwash Station - 2 Bay - Left - SK, 60 Second Flush	0.001	<0.001	mg/L	
250228J004	2A	Kitchen Dishwash Station - SK, Initial	0.001	0.009	mg/L	H
250228J005	2B	Kitchen Dishwash Station - SK, 15 Second Flush	0.001	<0.001	mg/L	
250228J006	2C	Kitchen Dishwash Station - SK, 60 Second Flush	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

Appendix E

Jack Abrams STEM Magnet School

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2001-1	Kitchen Handwash by entrance	SK	N/A		1/29/2025				Sign
2001-2	Kitchen Food Prep @ A	SK	App	1.0	2/27/2025				Remediation Complete
				8.0	1/29/2025				Removed from service; pending remediation
2001-3	Kitchen New Prep Sink by Pot Shelf	SK	App	<1.0	2/27/2025				Remediation Complete
				8.0	1/29/2025				Removed from service; pending remediation
2001-3	Kitchen Warewashing @ A	SK	N/A		1/29/2025				Sign
2001-4	Kitchen Warewashing @ B	SPY	N/A		1/29/2025				Sign
2001-5	Kitchen Warewashing @ C	SK	N/A		1/29/2025				Sign
2001-6	Kitchen Island	SK	App	2.0	1/29/2025				
2001-7	Kitchen Potfiller North-right	SK	App	11.0	2/27/2025	<1.0	<1.0		Removed from service; pending fixture replacement
				9.0	1/29/2025				Removed from service; pending remediation
2001-8	Kitchen Handwash @by Dishwasher	SK	N/A		1/29/2025				Sign
2001-9	Kitchen Handwash by Dishwasher exit	SK	N/A		1/29/2025				Sign
2001-10	Kitchen Food Prep opposite DW	SK	App	2.0	1/29/2025				
2001-11	Kitchen Potfiller South-left	SK	App	4.0	2/27/2025				Remediation Complete
				6.0	1/29/2025				Removed from service; pending remediation
2001-12	Kitchen Serving Line North	SK	N/A		1/29/2025				Sign
2001-13	Kitchen Serving Line South	SK	N/A		1/29/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2001-14	Kitchen Bathroom	SK	N/A		1/29/2025				Sign
2001-15	Kitchen Spray on Island	SK	N/A		1/29/2025				Sign
2002-1	Cafeteria	BF	App	<1.0	1/29/2025				
2002-1	Cafeteria	WF	App	<1.0	1/29/2025				
2002-2	Faculty Room	SK	App	5.0	1/29/2025				
2003-1	Custodial Closet by Custodial Office	SS	N/A		1/29/2025				Sign
2004-1	Room 211	SK	N/A		1/29/2025				Sign
2004-1	Room 211	WF	App	30.0	1/29/2025				Removed from service; pending remediation
2005-1	Room 209	SK	N/A		1/29/2025				Sign
2005-1	Room 209	WF	App	21.0	1/29/2025				Removed from service; pending remediation
2006-1	Boys Bathroom by Room 210 - Mens Faculty	SK	N/A		1/29/2025				Sign
2006-2	Boys Bathroom by Room 210 @ A	SK	N/A		1/29/2025				Sign
2006-3	Boys Bathroom by Room 210 @ B	SK	N/A		1/29/2025				Sign
2006-4	Boys Bathroom by Room 210 @ C	SK	N/A		1/29/2025				Sign
2006-5	Boys Bathroom by Room 210 @ D	SK	N/A		1/29/2025				Sign
2007-1	Custodial Closet by Room 210	SS	N/A		1/29/2025				Sign
2008-2	Girls Bathroom by Room 210 @ A	SK	N/A		1/29/2025				Sign
2008-3	Girls Bathroom by Room 210 @ B	SK	N/A		1/29/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2008-4	Girls Bathroom by Room 210 @ C	SK	N/A		1/29/2025				Sign
2008-5	Girls Bathroom by Room 210 @ D	SK	N/A		1/29/2025				Sign
2008-6	Girls Bathroom by Room 210 @ E	SK	N/A		1/29/2025				Sign
2009-1	Room 207	SK	N/A		1/29/2025				Sign
2009-2	Room 207	WF	App		1/29/2025				Removed from Service
2010-1	Room 205	SK	N/A		1/29/2025				Sign
2010-2	Room 205	WF	App	21.0	1/29/2025				Removed from service; pending remediation
2011-1	Room 203	SK	N/A		1/29/2025				Sign
2011-2	Room 203	WF	App	24.0	1/29/2025				Removed from service; pending remediation
2012-1	Room 201	SK	N/A		1/29/2025				Sign
2012-2	Room 201	WF	App	7.0	1/29/2025				Removed from service; pending remediation
2013-1	Room 202	SK	N/A		1/29/2025				Sign
2013-2	Room 202	WF	App	37.0	1/29/2025				Removed from service; pending remediation
2014-1	STEM Director K-12 Room 202A	SK	App	7.0	2/27/2025	<1.0	<1.0	2/27/2025	Removed from service; pending fixture replacement
				25.0	1/29/2025				Removed from service; pending remediation
2015-1	Room 204	SK	N/A		1/29/2025				Sign
2015-2	Room 204	WF	App	6.0	1/29/2025				Removed from service; pending remediation
2016-1	Room 206	SK	N/A		1/29/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2016-2	Room 206	WF	App	13.0	1/29/2025				Removed from service; pending remediation
2017-1	Room 208	SK	N/A		1/29/2025				Sign
2017-2	Room 208	WF	App	20.0	1/29/2025				Removed from service; pending remediation
2018-1	Room 210	SK	N/A		1/29/2025				Sign
2018-2	Room 210	WF	App	13.0	1/29/2025				Removed from service; pending remediation
2018-3	Room 212	SK	N/A		1/29/2025				Sign
2018-4	Room 212	WF	App		1/29/2025				Removed from Service
2019-1	Girls Bathroom by Room 213 @ A	SK	N/A		1/29/2025				Sign
2019-2	Girls Bathroom by Room 213 @ B	SK	N/A		1/29/2025				Sign
2020-1	Boys Bathroom by Room 213 @ A	SK	N/A		1/29/2025				Sign
2020-2	Boys Bathroom by Room 213 @ B	SK	N/A		1/29/2025				Sign
2021-1	Room 214	SK	N/A		1/29/2025				Sign
2021-2	Room 214	WF	App	13.0	1/29/2025				Removed from service; pending remediation
2022-1	Room 216	SK	N/A		1/29/2025				Sign
2022-2	Room 216	WF	App	4.0	1/29/2025				
2023-2	Room 218	WF	App	10.0	1/29/2025				Removed from service; pending remediation
2024-1	Room 220	SK	N/A		1/29/2025				Sign
2024-2	Room 220	WF	App	13.0	1/29/2025				Removed from service; pending remediation

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2025-1	Room 221	SK	N/A		1/29/2025				Sign
2025-2	Room 221	WF	App	10.0	1/29/2025				Removed from service; pending remediation
2026-1	Mens Bathroom by Room 221	SK	N/A		1/29/2025				Sign
2027-1	Custodial Closet by Room 221	SS	N/A		1/29/2025				Sign
2028-1	Womens Bathroom by Room 221	SK	N/A		1/29/2025				Sign
2029-1	Room 219	SK	N/A		1/29/2025				Sign
2029-2	Room 219	WF	App	15.0	1/29/2025				Removed from service; pending remediation
2030-1	Room 217	SK	N/A		1/29/2025				Sign
2030-2	Room 217	WF	App	14.0	1/29/2025				Removed from service; pending remediation
2031-1	Room 215	SK	N/A		1/29/2025				Sign
2031-2	Room 215	WF	App	20.0	1/29/2025				Removed from service; pending remediation
2032-1	Room 213	SK	N/A		1/29/2025				Sign
2032-2	Room 213	WF	App	14.0	1/29/2025				Removed from service; pending remediation
1001-1	Boiler Room Bathroom	SK	N/A		1/29/2025				Sign
1002-1	Custodial Closet by Boiler Room	SS	N/A		1/29/2025				Sign
1003-1	Bathroom by Superintendent	SK	N/A		1/29/2025				Sign
1004-1	Administration Breakroom	SK	App	6.0	2/27/2025	<1.0	<1.0	2/27/2025	Removed from service; pending fixture replacement
				14.0	1/29/2025				Removed from service; pending remediation

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1004-2	Administration Breakroom	WF	App	9.0	1/29/2025				Removed from service; pending remediation
1005-1	Assistant Superintendent	SK	N/A		1/29/2025				Sign
1005-2	Assistant Superintendent	WF	App		1/29/2025				Removed from Service
1006-1	Transportation	SK	App	15.0	2/27/2025	<1.0	<1.0	2/27/2025	Removed from service; pending fixture replacement
				7.0	1/29/2025				Removed from service; pending remediation
1006-2	Transportation	WF	App		1/29/2025				Removed from Service
1007-1	Treasurer	SK	App	5.0	1/29/2025				
1007-2	Treasurer	WF	App		1/29/2025				Removed from Service
1008-1	Human Resources	SK	App	10.0	2/27/2025	1/2/1900	<1.0	2/27/2025	Removed from service; pending fixture replacement
				6.0	1/29/2025				Removed from service; pending remediation
1008-2	Human Resources	WF	App		1/29/2025				Removed from Service
1009-1	Room 125	SK	App	2.0	1/29/2025				
1010-1	Girls Bathroom by Music Room	SK	N/A		1/29/2025				Sign
1011-1	Hallway by Book Storage	WF	App	4.0	1/29/2025				
1012-1	Boys Bathroom by Book Storage	SK	N/A		1/29/2025				Sign
1013-1	Room 110 Counter @ A	SK	N/A		1/29/2025				Sign
1013-2	Room 110 Counter @ B	SK	N/A		1/29/2025				Sign
1014-1	Gym	BF	App	<1.0	1/29/2025				

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1014-1	Gym	WF	App	<1.0	1/29/2025				
1015-1	Room 112 Unit 1 @ A	SK	N/A		1/29/2025				Sign
1015-2	Room 112 Unit 1 @ B	SK	N/A		1/29/2025				Sign
1015-3	Room 112 Unit 1 @ C	SK	N/A		1/29/2025				Sign
1015-4	Room 112 Unit 2 @ A	SK	N/A		1/29/2025				Sign
1015-5	Room 112 Unit 2 @ B	SK	N/A		1/29/2025				Sign
1015-6	Room 112 Unit 2 @ C	SK	N/A		1/29/2025				Sign
1016-1	Custodial Closet by Auditorium	SS	N/A		1/29/2025				Sign
1017-1	Womens Bathroom by Gym	SK	N/A		1/29/2025				Sign
1018-1	Mens Bathroom by Gym	SK	N/A		1/29/2025				Sign
1019-1	Girls Locker Room	WF	App		1/29/2025				Removed from Service
1019-2	Girls Locker Room @ A	SK	N/A		1/29/2025				Sign
1019-3	Girls Locker Room @ B	SK	N/A		1/29/2025				Sign
1020-1	Boys Locker Room	SK	N/A		1/29/2025				Sign
1020-2	Boys Locker Room	WF	App	87.0	1/29/2025				Removed from service; pending remediation
1021-1	Hallway by Main Office	BF	App	1.0	1/29/2025				
1021-2	Hallway by Main Office	WF	App	<1.0	1/29/2025				
1022-1	Main Office Bathroom	SK	N/A		1/29/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1023-1	Nurses Office	SK	App	2.0	1/29/2025				
1023-2	Nurses Office Bathroom	SK	App	5.0	1/29/2025				
1025-1	Hallway by Room 122	WF	App	2.0	1/29/2025				
1026-1	Girls Bathroom by Room 118	SK	N/A		1/29/2025				Sign
1024-1	Room 118	SK	N/A		1/29/2025				Sign
1025-1	Room 118	WF	App		1/29/2025				Removed from Service
1026-1	Room 118 Bathroom	SK	N/A		1/29/2025				Sign
1027-2	Room 117	WF	App		1/29/2025				Removed from Service
1027-3	Room 117 Bathroom	SK	N/A		1/29/2025				Sign
1028-1	Custodial Closet by Room 117	SS	N/A		1/29/2025				Sign
1029-1	Room 116	SK	N/A		1/29/2025				Sign
1029-2	Room 116	WF	App		1/29/2025				Removed from Service
1029-3	Room 116 Bathroom	SK	N/A		1/29/2025				Sign
1030-1	Room 115	SK	N/A		1/29/2025				Sign
1030-2	Room 115	WF	App		1/29/2025				Removed from Service
1030-3	Room 115 Bathroom	SK	N/A		1/29/2025				Sign
1031-1	Room 114	SK	N/A		1/29/2025				Sign
1031-2	Room 114	WF	App		1/29/2025				Removed from Service

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1031-3	Room 114 Bathroom	SK	N/A		1/29/2025				Sign

Laboratory Report

NYE Report #: 2500361-32221

January 31, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington UFSD; Jack Abrams STEM Magnet School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on January 29, 2025. New York Environmental analyzed the samples on January 30, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	29 Jan 2025
Date Received:	29 Jan 2025
Date Analyzed:	30 Jan 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250129O094	1	Kitchen Food Prep @ A-SK, Initial	0.001	0.008	mg/L	H
250129O095	2	Kitchen New Prep Sink by Pot Shelf-SK, Initial	0.001	0.008	mg/L	H
250129O096	3	Kitchen Island-SK, Initial	0.001	0.002	mg/L	
250129O097	4	Kitchen Potfiller North-right-SK, Initial	0.001	0.009	mg/L	H
250129O098	5	Kitchen Food Prep opposite DW-SK, Initial	0.001	0.002	mg/L	
250129O099	6	Kitchen Potfiller South-left-SK, Initial	0.001	0.006	mg/L	H
250129O100	7	Cafeteria-BF, Initial	0.001	<0.001	mg/L	
250129O101	8	Cafeteria-WF, Initial	0.001	<0.001	mg/L	
250129O102	9	Room 211-WF, Initial	0.001	0.030	mg/L	H
250129O103	10	Room 205-WF, Initial	0.001	0.021	mg/L	H
250129O104	11	Room 203-WF, Initial	0.001	0.024	mg/L	H
250129O105	12	Room 201-WF, Initial	0.001	0.007	mg/L	H
250129O106	13	Room 202-WF, Initial	0.001	0.037	mg/L	H
250129O107	14	STEM Director K-12 Room 202A-SK, Initial	0.001	0.025	mg/L	H
250129O108	15	Room 204-WF, Initial	0.001	0.006	mg/L	H
250129O109	16	Room 206-WF, Initial	0.001	0.013	mg/L	H
250129O110	17	Room 208-WF, Initial	0.001	0.020	mg/L	H
250129O111	18	Room 210-WF, Initial	0.001	0.013	mg/L	H
250129O112	19	Faculty Room-SK, Initial	0.001	0.005	mg/L	
250129O113	20	Room 214-WF, Initial	0.001	0.013	mg/L	H
250129O114	21	Room 216-WF, Initial	0.001	0.004	mg/L	
250129O115	22	Room 218-WF, Initial	0.001	0.010	mg/L	H
250129O116	23	Room 220-WF, Initial	0.001	0.013	mg/L	H
250129O117	24	Room 221-WF, Initial	0.001	0.010	mg/L	H
250129O118	25	Room 219-WF, Initial	0.001	0.015	mg/L	H
250129O119	26	Room 217-WF, Initial	0.001	0.014	mg/L	H

Date Collected:	29 Jan 2025
Date Received:	29 Jan 2025
Date Analyzed:	30 Jan 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250129O120	27	Room 215-WF, Initial	0.001	0.020	mg/L	H
250129O121	28	Room 213-WF, Initial	0.001	0.014	mg/L	H
250129O122	29	Administration Breakroom-SK, Initial	0.001	0.014	mg/L	H
250129O123	30	Administration Breakroom-WF, Initial	0.001	0.009	mg/L	H
250129O124	31	Transportation-SK, Initial	0.001	0.007	mg/L	H
250129O125	32	Treasurer-SK, Initial	0.001	0.005	mg/L	
250129O126	33	Human Resources-SK, Initial	0.001	0.006	mg/L	H
250129O127	34	Room 125-SK, Initial	0.001	0.002	mg/L	
250129O128	35	Hallway by Book Storage-WF, Initial	0.001	0.004	mg/L	
250129O129	36	Gym-BF, Initial	0.001	<0.001	mg/L	
250129O130	37	Gym-WF, Initial	0.001	<0.001	mg/L	
250129O131	38	Boys Locker Room-WF, Initial	0.001	0.087	mg/L	E,H
250129O132	39	Hallway by Main Office-BF, Initial	0.001	0.001	mg/L	
250129O133	40	Hallway by Main Office-WF, Initial	0.001	<0.001	mg/L	
250129O134	41	Nurses Office-SK, Initial	0.001	0.002	mg/L	
250129O135	42	Nurses Office Bathroom-SK, Initial	0.001	0.005	mg/L	
250129O136	43	Hallway by Room 122-WF, Initial	0.001	0.002	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

E: Sample result exceeds instrument calibration, value is estimated.

H: Sample result exceeds applicable regulatory limit.

Laboratory Report

NYE Report #: 2500755-32496

March 3, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington UFSD; Jack Abrams STEM Magnet School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on February 28, 2025. New York Environmental analyzed the samples on March 03, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	27 Feb 2025
Date Received:	28 Feb 2025
Date Analyzed:	03 Mar 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250228K016	1A	Kitchen New Prep Sink by Pot Shelf-SK, Initial	0.001	<0.001	mg/L	
250228K017	1B	Kitchen New Prep Sink by Pot Shelf-SK, 15 Second Flush	0.001	NA	mg/L	
250228K018	1C	Kitchen New Prep Sink by Pot Shelf-SK, 60 Second Flush	0.001	NA	mg/L	
250228K019	2A	Kitchen Food Prep @A-SK, Initial	0.001	0.001	mg/L	
250228K020	2B	Kitchen Food Prep @A-SK, 15 Second Flush	0.001	NA	mg/L	
250228K021	2C	Kitchen Food Prep @A-SK, 60 Second Flush	0.001	NA	mg/L	
250228K022	3A	Kitchen Pot Filler North-Right-PF, Initial	0.001	0.011	mg/L	H
250228K023	3B	Kitchen Pot Filler North-Right-PF, 15 Second Flush	0.001	<0.001	mg/L	
250228K024	3C	Kitchen Pot Filler North-Right-PF, 60 Second Flush	0.001	<0.001	mg/L	
250228K025	4A	Kitchen Pot Filler South-Left-PF, Initial	0.001	0.004	mg/L	
250228K026	4B	Kitchen Pot Filler South-Left-PF, 15 Second Flush Kitchen	0.001	NA	mg/L	
250228K027	4C	Pot Filler North-Left-PF, 60 Second Flush	0.001	NA	mg/L	
250228K028	5A	STEM Director K-12 Room 202A-SK, Initial	0.001	0.007	mg/L	H
250228K029	5B	STEM Director K-12 Room 202A-SK, 15 Second Flush	0.001	<0.001	mg/L	
250228K030	5C	STEM Director K-12 Room 202A-SK, 60 Second Flush	0.001	<0.001	mg/L	
250228K031	6A	Transportation-SK, Initial	0.001	0.015	mg/L	H
250228K032	6B	Transportation-SK, 15 Second Flush	0.001	<0.001	mg/L	
250228K033	6C	Transportation-SK, 60 Second Flush	0.001	<0.001	mg/L	
250228K034	7A	Human Resources-SK, Initial	0.001	0.010	mg/L	H
250228K035	7B	Human Resources-SK, 15 Second Flush	0.001	0.002	mg/L	
250228K036	7C	Human Resources-SK, 60 Second Flush	0.001	<0.001	mg/L	
250228K037	8A	Administration Break Room-SK, Initial	0.001	0.006	mg/L	H
250228K038	8B	Administration Break Room-SK, 15 Second Flush	0.001	<0.001	mg/L	
250228K039	8C	Administration Break Room-SK, 60 Second Flush	0.001	<0.001	mg/L	

Date Collected:	27 Feb 2025
Date Received:	28 Feb 2025
Date Analyzed:	03 Mar 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
--------	-----	-----------------------------	-----	--------	-------	------

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

Appendix F

Woodhull Intermediate School

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1001-1	Kitchen Prep	SK	App	1.0	1/29/2025				
1001-2	Kitchen Custodial Closet	SK	N/A		1/29/2025				Sign
1001-3	Kitchen Sanitizer Station @ A	SK	N/A		1/29/2025				Sign
1001-4	Kitchen Sanitizer Station	SY	N/A		1/29/2025				Sign
1001-5	Kitchen Sanitizer Station @ B	SK	N/A		1/29/2025				Sign
1001-6	Kitchen Handwash	SK	N/A		1/29/2025				Sign
1001-7	Kitchen Bathroom	SK	N/A		1/29/2025				Sign
1002-1	Faculty Lounge	SK	N/A		1/29/2025				Sign
1003-1	Mens Faculty Bathroom in Main Lobby @ A	SK	N/A		1/29/2025				Sign
1003-2	Mens Faculty Bathroom in Main Lobby @ B	SK	N/A		1/29/2025				Sign
1004-1	Womens Faculty Bathroom in Main Lobby @ A	SK	N/A		1/29/2025				Sign
1004-2	Womens Faculty Bathroom in Main Lobby @ B	SK	N/A		1/29/2025				Sign
1005-1	Room 2	SK	N/A		1/29/2025				Sign
1006-1	Room 3	SK	N/A		1/29/2025				Sign
1007-1	Room 4	SK	N/A		1/29/2025				Sign
1008-1	Room 5	SK	N/A		1/29/2025				Sign
1008-2	Room 5	WF	App	7.0	1/29/2025				Capped
1009-1	Room 6	SK	N/A		1/29/2025				Sign
1010-1	Room 7	SK	N/A		1/29/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1010-2	Room 7	WF	App	9.0	1/29/2025				Capped
1010-3	Room 7 Bathroom	SK	N/A		1/29/2025				Sign
1011-1	Room 8 Bathroom	SK	N/A		1/29/2025				Sign
1011-2	Room 8	SK	N/A		1/29/2025				Sign
1011-3	Room 8	WF	App	12.0	1/29/2025				Capped
1012-1	Room 10	SK	N/A		1/29/2025				Sign
1012-2	Room 10	WF	App		1/29/2025				Non-functional; sampling required before returning to service
1012-3	Room 10 Bathroom	SK	N/A		1/29/2025				Sign
1013-1	Room 11	SK	N/A		1/29/2025				Sign
1013-2	Room 11	WF	App	9.0	1/29/2025				Capped
1013-3	Room 11 Bathroom	SK	N/A		1/29/2025				Sign
1014-2	Room 12	WF	App	3.0	1/29/2025				
1015-1	Girls Bathroom by Room 12 @ A	SK	N/A		1/29/2025				Sign
1015-2	Girls Bathroom by Room 12 @ B	SK	N/A		1/29/2025				Sign
1015-3	Girls Bathroom by Room 12 @ C	SK	N/A		1/29/2025				Sign
1015-4	Girls Bathroom by Room 12 in Womens Faculty	SK	N/A		1/29/2025				Sign
1016-1	Hallway by Room 12	BF	App	<1.0	1/29/2025				
1016-1	Hallway by Room 12	WF	App	<1.0	1/29/2025				
1017-1	Custodial Closet by Room 12	SS	N/A		1/29/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1018-1	Boys Bathroom by Room 12 @ A	SK	N/A		1/29/2025				Sign
1018-2	Boys Bathroom by Room 12 @ B	SK	N/A		1/29/2025				Sign
1018-3	Boys Bathroom by Room 12 @ C	SK	N/A		1/29/2025				Sign
1018-4	Boys Bathroom by Room 12 in Mens Faculty	SK	N/A		1/29/2025				Sign
1019-1	Main Office Bathroom	SK	N/A		1/29/2025				Sign
1019-2	Main Office Break Room	SK	N/A		1/29/2025				Sign
1020-1	Nurse's Office Bathroom	SK	N/A		1/29/2025				Sign
1021-1	Hallway by Room 15	BF	App	<1.0	1/29/2025				
1021-2	Hallway by Room 15	WF	App	<1.0	1/29/2025				
1022-1	Room 27 Counter @ A	SK	N/A		1/29/2025				Sign
1022-2	Room 27 Counter @ B	SK	N/A		1/29/2025				Sign
1023-1	Boys Bathroom by Room 26 @ A	SK	N/A		1/29/2025				Sign
1023-2	Boys Bathroom by Room 26 @ B	SK	N/A		1/29/2025				Sign
1023-3	Boys Bathroom by Room 26 @ C	SK	N/A		1/29/2025				Sign
1023-4	Boys Bathroom by Room 26 in Mens Faculty	SK	N/A		1/29/2025				Sign
1024-1	Custodial Closet by Room 26	SS	N/A		1/29/2025				Sign
1025-1	Hallway by Room 26	WF	App	4.0	1/29/2025				
1026-1	Girls Bathroom by Room 26 @ A	SK	N/A		1/29/2025				Sign
1026-2	Girls Bathroom by Room 26 @ B	SK	N/A		1/29/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1026-3	Girls Bathroom by Room 26 @ C	SK	N/A		1/29/2025				Sign
1026-4	Girls Bathroom by Room 26 in Womens Faculty	SK	N/A		1/29/2025				Sign
1027-1	Room 26	SK	N/A		1/29/2025				Sign
1027-2	Room 26	WF	App		1/29/2025				Non-functional; sampling required before returning to service
1028-1	Room 25 Bathroom	SK	N/A		1/29/2025				Sign
1028-2	Room 25	SK	N/A		1/29/2025				Sign
1028-3	Room 25	WF	App		1/29/2025				Non-functional; sampling required before returning to service
1029-1	Room 24 Bathroom	SK	N/A		1/29/2025				Sign
1029-3	Room 24	SK	N/A		1/29/2025				Sign
1030-1	Room 22	SK	N/A		1/29/2025				Sign
1030-2	Room 22	WF	App		1/29/2025				Non-functional; sampling required before returning to service
1030-3	Room 22 Bathroom	SK	N/A		1/29/2025				Sign
1031-1	Room 21 Bathroom	SK	N/A		1/29/2025				Sign
1031-2	Room 21	SK	N/A		1/29/2025				Sign
1031-3	Room 21	WF	App	18.0	1/29/2025				Capped
1032-1	Room 20	WF	App		1/29/2025				Non-functional; sampling required before returning to service
1032-2	Room 20 Bathroom	SK	N/A		1/29/2025				Sign
1032-3	Room 20	SK	N/A		1/29/2025				Sign
1033-1	Room 19	SK	N/A		1/29/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1033-2	Room 19 Bathroom	SK	N/A		1/29/2025				Sign
1033-3	Room 19	WF	App		1/29/2025				Non-functional; sampling required before returning to service
1034-1	Room 18	SK	N/A		1/29/2025				Sign
1034-2	Room 18 Bathroom	SK	N/A		1/29/2025				Sign
1034-3	Room 18	WF	App	38.0	1/29/2025				Capped
1035-1	Room 17	SK	N/A		1/29/2025				Sign
1035-2	Room 17	WF	App		1/29/2025				Non-functional; sampling required before returning to service
1035-3	Room 17 Bathroom	SK	N/A		1/29/2025				Sign
1036-1	Room 16	SK	N/A		1/29/2025				Sign
1036-2	Room 16	WF	App		1/29/2025				Non-functional; sampling required before returning to service
1036-3	Room 16 Bathroom	SK	N/A		1/29/2025				Sign
1037-1	Room 15	SK	N/A		1/29/2025				Sign
1037-2	Room 15	WF	App	7.0	1/29/2025				Capped
1037-3	Room 15 Bathroom	SK	App		1/29/2025				
1038-1	Room 14 Faculty Room	SK	App	<1.0	1/29/2025				
1038-2	Room 14B Bathroom	SK	N/A		1/29/2025				Sign
1039-1	Custodial Office	SS	N/A		1/29/2025				Sign
1039-2	Custodial Office Bathroom	SK	N/A		1/29/2025				Sign
1040-1	Hallway by Custodial Office	WF	App	47.0	1/29/2025				Removed from service, fixture replacement planned

Laboratory Report

NYE Report #: 2500359-32219

January 31, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington UFSD; Woodhull Intermediate School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on January 29, 2025. New York Environmental analyzed the samples on January 31, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	29 Jan 2025
Date Received:	29 Jan 2025
Date Analyzed:	31 Jan 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250129O038	1	Kitchen Prep-SK, Initial	0.001	0.001	mg/L	
250129O039	2	Room 5-WF, Initial	0.001	0.007	mg/L	H
250129O040	3	Room 7-WF, Initial	0.001	0.009	mg/L	H
250129O041	4	Room 8-WF, Initial	0.001	0.012	mg/L	H
250129O042	5	Room 11-WF, Initial	0.001	0.009	mg/L	H
250129O043	6	Room 12-WF, Initial	0.001	0.003	mg/L	
250129O044	7	Hallway by Room 12-BF, Initial	0.001	<0.001	mg/L	
250129O045	8	Hallway by Room 12-WF, Initial	0.001	<0.001	mg/L	
250129O046	9	Hallway by Room 15-BF, Initial	0.001	<0.001	mg/L	
250129O047	10	Hallway by Room 15-WF, Initial	0.001	<0.001	mg/L	
250129O048	11	Hallway by Room 26-WF, Initial	0.001	0.004	mg/L	
250129O049	12	Room 21-WF, Initial	0.001	0.018	mg/L	H
250129O050	13	Room 18-WF, Initial	0.001	0.038	mg/L	H
250129O051	14	Room 15-WF, Initial	0.001	0.007	mg/L	H
250129O052	15	Room 14 Faculty Room-SK, Initial	0.001	<0.001	mg/L	
250129O053	16	Hallway by Custodial Office-WF, Initial	0.001	0.047	mg/L	H

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

Appendix G

J. Taylor Finley School

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1001-1	Kitchen Handwash @ A	SK	N/A		1/28/2025				Sign
1001-2	Kitchen West Serving Line Handwash	SK	N/A		1/28/2025				Sign
1001-3	Dishwashing Station	SPY	N/A		1/28/2025				Sign
1001-4	Handwash across from Dishwashing Station	SK	N/A		1/28/2025				Sign
1001-5	Kitchen East Serving Line Sink	SK	App	3.0	1/28/2025				
1001-6	Kitchen Sanitizer Station	SK	N/A		1/28/2025				Sign
1001-7	Kitchen Sanitizer Station	SPY	N/A		1/28/2025				Sign
1001-8	Kitchen Handwash by Sanitizer	SK	N/A		1/28/2025				Sign
1001-9	Kitchen New Prep by Sanitizer	SK	App	4.0	2/27/2025				Remediation Complete
				8.0	1/28/2025				Removed from service; pending remediation
1001-9	Kitchen Pot Filler at Stove	SP	App	1.0	2/27/2025				Remediation Complete
				8.0	1/28/2025				Removed from service; pending remediation
1001-10	Kitchen Pot Filler at Steamer	SP	App	4.0	1/28/2025				
1001-11	Kitchen Prep Sink - left	SK	App	5.0	1/28/2025				
1001-12	Kitchen Prep Sink - right	SK	App	4.0	1/28/2025				
1001-13	Dishwashing Station Handwash	SK	N/A		1/28/2025				Sign
1001-14	Kitchen Bathroom	SK	N/A		1/28/2025				Sign
1001-15	Kitchen	SS	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1001-16	Ice Machine in Storage Closet	IM	App	<1.0	1/28/2025				
1002-1	Custodian Bathroom	SK	N/A		1/28/2025				Sign
1003-1	Hallway by Custodian Bathroom	BF	App	<1.0	1/28/2025				
1003-2	Hallway by Custodian Bathroom	WF	App	<1.0	1/28/2025				
1004-1	Custodian Closet by Custodian Bathroom	SS	N/A		1/28/2025				Sign
1005-1	Girls Locker Room Custodian Closet	SS	N/A		1/28/2025				Sign
1005-2	Girls Locker Room Bathroom @ A	SK	N/A		1/28/2025				Sign
1005-3	Girls Locker Room Bathroom @ B	SK	N/A		1/28/2025				Sign
1006-1	Girls Coach's Office Bathroom	SK	N/A		1/28/2025				Sign
1006-2	Hallway by Girls Coach's Office	WF	App	19.0	2/27/2025	3.0	3.0	2/27/2025	Removed from service; pending fixture replacement
				8.0	1/28/2025				Removed from service; pending remediation
1007-1	Hallway by Boys Coach's Office	WF	App	3.0	1/28/2025				
1008-1	Boys Coach's Office Bathroom	SK	N/A		1/28/2025				Sign
1009-1	Boys Locker Room Custodian Closet	SS	N/A		1/28/2025				Sign
1009-2	Boys Locker Room Bathroom @ A	SK	N/A		1/28/2025				Sign
1009-4	Boys Locker Room	WF	App	6.0	1/28/2025				Removed from service; pending remediation
1010-1	Mens Bathroom by Boys Locker Room	SK	N/A		1/28/2025				Sign
1011-1	Room 302 Unit @ A	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1011-2	Room 302 Unit @ B	SK	N/A		1/28/2025				Sign
1011-3	Room 302 Unit @ C	SK	N/A		1/28/2025				Sign
1012-1	Room 301 Unit @ A	SK	N/A		1/28/2025				Sign
1012-2	Room 301 Unit @ B	SK	N/A		1/28/2025				Sign
1012-3	Room 301 Unit @ C	SK	N/A		1/28/2025				Sign
1013-1	Room 110 Teacher's Station	SK	N/A		1/28/2025				Sign
1013-2	Room 110 Table 1	SK	N/A		1/28/2025				Sign
1013-3	Room 110 Table 2	SK	N/A		1/28/2025				Sign
1013-4	Room 110 Table 3	SK	N/A		1/28/2025				Sign
1013-5	Room 110 Table 4	SK	N/A		1/28/2025				Sign
1013-6	Room 110 Table 5	SK	N/A		1/28/2025				Sign
1013-7	Room 110 Table 6	SK	N/A		1/28/2025				Sign
1013-8	Room 110 Table 7	SK	N/A		1/28/2025				Sign
1014-1	Prep Room 110 / 109 Counter 1 @ A	SK	N/A		1/28/2025				Sign
1014-2	Prep Room 110 / 109 Counter 1 @ B	SK	N/A		1/28/2025				Sign
1014-3	Prep Room 110 / 109 Counter 2	SK	N/A		1/28/2025				Sign
1015-1	Room 109 Teacher's Station	SK	N/A		1/28/2025				Sign
1015-2	Room 109 Table 1	SK	N/A		1/28/2025				Sign

Huntington UFSD
J. Taylor Finley Middle School

School Water Outlet Inventory

Lead in School Drinking Water Program 2023 - 2025

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1015-3	Room 109 Table 2	SK	N/A		1/28/2025				Sign
1015-4	Room 109 Table 3	SK	N/A		1/28/2025				Sign
1015-5	Room 109 Table 4	SK	N/A		1/28/2025				Sign
1015-6	Room 109 Table 5	SK	N/A		1/28/2025				Sign
1015-7	Room 109 Table 6	SK	N/A		1/28/2025				Sign
1015-8	Room 109 Table 7	SK	N/A		1/28/2025				Sign
1016-1	Custodian Closet by Room 109	SS	N/A		1/28/2025				Sign
1017-1	Hallway by Room 108	WF	App	5.0	1/28/2025				
1017-2	Hallway by Room 105	WF	App	<1.0	1/28/2025				
1018-1	Boys Bathroom Blue Floor @ A	SK	N/A		1/28/2025				Sign
1018-2	Boys Bathroom Blue Floor @ B	SK	N/A		1/28/2025				Sign
1018-3	Boys Bathroom Blue Floor @ C	SK	N/A		1/28/2025				Sign
1018-4	Boys Bathroom Blue Floor @ D	SK	N/A		1/28/2025				Sign
1019-2	Lobby Blue Floor	BF	App	<1.0	1/28/2025				
1019-2	Lobby Blue Floor	WF	App	<1.0	1/28/2025				
1020-1	Girls Bathroom Blue Floor @ A	SK	N/A		1/28/2025				Sign
1020-2	Girls Bathroom Blue Floor @ B	SK	N/A		1/28/2025				Sign
1021-1	Principal's Office Bathroom	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1021-2	Main Office Break Room Bathroom	SK	App	5.0	1/28/2025				
1022-1	Nurse's Office Break Area	SK	App	4.0	1/28/2025				
1022-2	Nurse's Office	SK	App	4.0	1/28/2025				
1022-3	Nurse's Office Bathroom	SK	N/A		1/28/2025				Sign
1023-1	All Gender Bathroom by ISS Room	SK	N/A		1/28/2025				Sign
1024-1	Hallway by Main Office	WF	App	4.0	1/28/2025				
1025-1	Men Faculty Bathroom by Room 123	SK	N/A		1/28/2025				Sign
1026-1	Boys Bathroom by Room 123 @ A	SK	N/A		1/28/2025				Sign
1026-2	Boys Bathroom by Room 123 @ B	SK	N/A		1/28/2025				Sign
1026-3	Boys Bathroom by Room 123 @ C	SK	N/A		1/28/2025				Sign
1027-1	Girls Bathroom by Room 123 @ A	SK	N/A		1/28/2025				Sign
1027-2	Girls Bathroom by Room 123 @ B	SK	N/A		1/28/2025				Sign
1027-3	Girls Bathroom by Room 123 @ C	SK	N/A		1/28/2025				Sign
1027-4	Hallway by Room 123	WF	App	7.0	2/27/2025	2.0	1.0	2/27/2025	Removed from service; pending fixture replacement
				8.0	1/28/2025				Removed from service; pending remediation
1028-1	Custodian Closet by Room 116	SS	N/A		1/28/2025				Sign
1029-1	Room 116 Teacher's Station	SK	N/A		1/28/2025				Sign
1029-2	Room 116 Table 1	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1029-3	Room 116 Table 2	SK	N/A		1/28/2025				Sign
1029-4	Room 116 Table 3	SK	N/A		1/28/2025				Sign
1029-5	Room 116 Table 4	SK	N/A		1/28/2025				Sign
1029-6	Room 116 Table 5	SK	N/A		1/28/2025				Sign
1029-7	Room 116 Table 6	SK	N/A		1/28/2025				Sign
1029-8	Room 116 Table 7	SK	N/A		1/28/2025				Sign
1030-1	Prep Room 116 Counter 1 @ A	SK	N/A		1/28/2025				Sign
1030-2	Prep Room 116 Counter 1 @ B	SK	N/A		1/28/2025				Sign
1030-3	Prep Room 116 Counter 2	SK	N/A		1/28/2025				Sign
1031-1	Hallway by Room 115	WF	App	4.0	1/28/2025				
1032-1	Mens Bathroom by Faculty Room	SK	N/A		1/28/2025				Sign
1033-1	Womens Bathroom by Faculty Room	SK	N/A		1/28/2025				Sign
1034-1	Audio Visual Room	SK	App	2.0	1/28/2025				
1035-1	Hallway by Room 112	WF	App	9.0	1/28/2025				Removed from service; pending remediation
2001-1	Room 223 Unit @ A	SK	N/A		1/28/2025				Sign
2001-2	Room 223 Unit @ B	SK	N/A		1/28/2025				Sign
2001-3	Room 223 Unit @ C	SK	N/A		1/28/2025				Sign
2001-4	Room 223 Unit @ D	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2001-5	Room 223 Unit @ E	SK	N/A		1/28/2025				Sign
2001-6	Room 223 Unit @ F	SK	N/A		1/28/2025				Sign
2002-1	Room 222 Unit @ A	SK	N/A		1/28/2025				Sign
2002-2	Room 222 Unit @ B	SK	N/A		1/28/2025				Sign
2002-3	Room 222 Unit @ C	SK	N/A		1/28/2025				Sign
2002-4	Room 222 Unit @ D	SK	N/A		1/28/2025				Sign
2002-5	Room 222 Unit @ E	SK	N/A		1/28/2025				Sign
2002-6	Room 222 Unit @ F	SK	N/A		1/28/2025				Sign
2003-1	Hallway by Room 221	WF	App		1/28/2025				Non-functional; sampling required before returning to service
2004-1	Room 221 Counter @ A	SK	N/A		1/28/2025				Sign
2004-2	Room 221 Counter @ B	SK	N/A		1/28/2025				Sign
2005-1	Hallway by Room 218	WF	App	5.0	1/28/2025				
2006-1	Boys Bathroom by Room 218 @ A	SK	N/A		1/28/2025				Sign
2006-2	Boys Bathroom by Room 218 @ B	SK	N/A		1/28/2025				Sign
2006-3	Boys Bathroom by Room 218 @ C	SK	N/A		1/28/2025				Sign
2007-1	Mens Faculty Bathroom inside Boys Bathroom	SK	N/A		1/28/2025				Sign
2008-1	Girls Bathroom by Room 211 @ A	SK	N/A		1/28/2025				Sign
2008-2	Girls Bathroom by Room 211 @ B	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2009-1	Womens Faculty Bathroom inside Girls Bathro	SK	N/A		1/28/2025				Sign
2010-1	Custodian Closet by Room 211	SS	N/A		1/28/2025				Sign
2011-1	Room 211 Teacher's Station	SK	N/A		1/28/2025				Sign
2011-2	Room 211 Table 1	SK	N/A		1/28/2025				Sign
2011-4	Room 211 Table 3	SK	N/A		1/28/2025				Sign
2011-5	Room 211 Table 4	SK	N/A		1/28/2025				Sign
2011-6	Room 211 Table 5	SK	N/A		1/28/2025				Sign
2011-7	Room 211 Table 6	SK	N/A		1/28/2025				Sign
2011-8	Room 211 Table 7	SK	N/A		1/28/2025				Sign
2012-1	Prep Room 211 / 210 Counter 1 @ A	SK	N/A		1/28/2025				Sign
2012-2	Prep Room 211 / 210 Counter 1 @ B	SK	N/A		1/28/2025				Sign
2012-3	Prep Room 211 / 210 Counter 2	SK	N/A		1/28/2025				Sign
2013-1	Hallway by Room 210	WF	App	3.0	1/28/2025				
2014-1	Room 210 Teacher's Station	SK	N/A		1/28/2025				Sign
2014-2	Room 210 Table 1	SK	N/A		1/28/2025				Sign
2014-3	Room 210 Table 2	SK	N/A		1/28/2025				Sign
2014-4	Room 210 Table 3	SK	N/A		1/28/2025				Sign
2014-5	Room 210 Table 4	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2014-6	Room 210 Table 5	SK	N/A		1/28/2025				Sign
2014-7	Room 210 Table 6	SK	N/A		1/28/2025				Sign
2014-8	Room 210 Table 7	SK	N/A		1/28/2025				Sign
2015-1	Library Office	SK	App	1.0	1/28/2025				
2016-1	Room 208 Station 1	SK	App	19.0	2/27/2025	4.0	4.0	2/27/2025	Removed from service; pending fixture replacement
				10.0	1/28/2025				Removed from service; pending remediation
2016-2	Room 208 Station 2	SK	App	26.0	2/27/2025	1.0	2.0	2/27/2025	Removed from service; pending fixture replacement
				9.0	1/28/2025				Removed from service; pending remediation
2016-3	Room 208 Station 3	SK	App	26.0	2/27/2025	2.0	1.0	2/27/2025	Removed from service; pending fixture replacement
				12.0	1/28/2025				Removed from service; pending remediation
2016-4	Room 208 Station 4	SK	App	40.0	2/27/2025	3.0	2.0	2/27/2025	Removed from service; pending fixture replacement
				13.0	1/28/2025				Removed from service; pending remediation
2017-1	Hallway by Room 207	WF	App	139.0	2/27/2025	120.0	36.0	2/27/2025	Removed from service; pending fixture replacement
				7.0	1/28/2025				Removed from service; pending remediation
2018-1	Room 207 Station 1	SK	App	2.0	1/28/2025				
2018-2	Room 207 Station 2	SK	App	18.0	2/27/2025	3.0	<1.0	2/27/2025	Removed from service; pending fixture replacement
				9.0	1/28/2025				Removed from service; pending remediation
2018-3	Room 207 Station 3	SK	App	36.0	2/27/2025	3.0	1.0	2/27/2025	Removed from service; pending fixture replacement

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2018-3	Room 207 Station 3	SK	App	19.0	1/28/2025				Removed from service; pending remediation
2018-4	Room 207 Station 4	SK	App	14.0	2/27/2025	1.0	<1.0	2/27/2025	Removed from service; pending fixture replacement
				15.0	1/28/2025				Removed from service; pending remediation
2019-1	Room 205 Teacher's Station	SK	N/A		1/28/2025				Sign
2019-2	Room 205 Table 1	SK	N/A		1/28/2025				Sign
2020-1	Prep Room 205 / 204 Conter @ A	SK	N/A		1/28/2025				Sign
2020-2	Prep Room 205 / 204 Conter @ B	SK	N/A		1/28/2025				Sign
2020-3	Prep Room 205 / 204 Conter @ C	SK	N/A		1/28/2025				Sign
2021-1	Room 204 Teacher's Station	SK	N/A		1/28/2025				Sign
2021-2	Room 204 Table 1	SK	N/A		1/28/2025				Sign
2021-3	Room 204 Table 2	SK	N/A		1/28/2025				Sign
2021-4	Room 204 Table 3	SK	N/A		1/28/2025				Sign
2021-5	Room 204 Table 4	SK	N/A		1/28/2025				Sign
2021-6	Room 204 Table 5	SK	N/A		1/28/2025				Sign
2021-7	Room 204 Table 6	SK	N/A		1/28/2025				Sign
2021-8	Room 204 Table 7	SK	N/A		1/28/2025				Sign
2022-1	Custodian Closet by Room 204	SS	N/A		1/28/2025				Sign
2023-1	Girls Bathroom by Room 203 @ A	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2023-2	Girls Bathroom by Room 203 @ B	SK	N/A		1/28/2025				Sign
2023-3	Girls Bathroom by Room 203 @ C	SK	N/A		1/28/2025				Sign
2024-1	Women Faculty Bathroom inside Girls Bathroom	SK	N/A		1/28/2025				Sign
2025-1	Hallway by Room 203	WF	App	5.0	1/28/2025				
2026-1	Boys Bathroom by Room 201 @ A	SK	N/A		1/28/2025				Sign
2026-2	Boys Bathroom by Room 201 @ B	SK	N/A		1/28/2025				Sign
2026-3	Boys Bathroom by Room 201 @ C	SK	N/A		1/28/2025				Sign
2027-1	Men Faculty Bathroom inside Boys Bathroom	SK	N/A		1/28/2025				Sign

Laboratory Report

NYE Report #: 2500358-32218

January 31, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington UFSD; J. Taylor Finley Middle School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on January 29, 2025. New York Environmental analyzed the samples on January 30, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	28 Jan 2025
Date Received:	29 Jan 2025
Date Analyzed:	30 Jan 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250129O001	1	Kitchen East Serving Line Sink-SK, Initial	0.001	0.003	mg/L	
250129O002	2	Kitchen New Prep by Sanitizer-SK, Initial	0.001	0.008	mg/L	H
250129O003	3	Kitchen Pot Filler at Stove-SP, Initial	0.001	0.008	mg/L	H
250129O004	4	Kitchen Pot Filler at Steamer-SP, Initial	0.001	0.004	mg/L	
250129O005	5	Kitchen Prep Sink - left-SK, Initial	0.001	0.005	mg/L	
250129O006	6	Kitchen Prep Sink - right-SK, Initial	0.001	0.004	mg/L	
250129O007	7	Hallway by Custodian Bathroom-BF, Initial	0.001	<0.001	mg/L	
250129O008	8	Hallway by Custodian Bathroom-WF, Initial	0.001	<0.001	mg/L	
250129O009	9	Hallway by Girls Coach's Office-WF, Initial	0.001	0.008	mg/L	H
250129O010	10	Boys Locker Room-WF, Initial	0.001	0.006	mg/L	H
250129O011	11	Hallway by Boys Coach's Office-WF, Initial	0.001	0.003	mg/L	
250129O012	12	Hallway by Room 108-WF, Initial	0.001	0.005	mg/L	
250129O013	13	Hallway by Room 105-WF, Initial	0.001	<0.001	mg/L	
250129O014	14	Lobby Blue Floor-BF, Initial	0.001	<0.001	mg/L	
250129O015	15	Lobby Blue Floor-WF, Initial	0.001	<0.001	mg/L	
250129O016	16	Main Office Break Room Bathroom-SK, Initial	0.001	0.005	mg/L	
250129O017	17	Hallway by Main Office-WF, Initial	0.001	0.004	mg/L	
250129O018	18	Nurse's Office Break Area-SK, Initial	0.001	0.004	mg/L	
250129O019	19	Nurse's Office-SK, Initial	0.001	0.004	mg/L	
250129O020	20	Hallway by Room 123-WF, Initial	0.001	0.008	mg/L	H
250129O021	21	Hallway by Room 115-WF, Initial	0.001	0.004	mg/L	
250129O022	22	Audio Visual Room-SK, Initial	0.001	0.002	mg/L	
250129O023	23	Hallway by Room 112-WF, Initial	0.001	0.009	mg/L	H
250129O024	24	Library Office-SK, Initial	0.001	0.001	mg/L	
250129O025	25	Hallway by Room 218-WF, Initial	0.001	0.005	mg/L	
250129O026	26	Hallway by Room 210-WF, Initial	0.001	0.003	mg/L	

Date Collected:	28 Jan 2025
Date Received:	29 Jan 2025
Date Analyzed:	30 Jan 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250129O027	27	Room 208 Station 1-SK, Initial	0.001	0.010	mg/L	H
250129O028	28	Room 208 Station 2-SK, Initial	0.001	0.009	mg/L	H
250129O029	29	Room 208 Station 3-SK, Initial	0.001	0.012	mg/L	H
250129O030	30	Room 208 Station 4-SK, Initial	0.001	0.013	mg/L	H
250129O031	31	Hallway by Room 207-WF, Initial	0.001	0.007	mg/L	H
250129O032	32	Room 207 Station 1-SK, Initial	0.001	0.002	mg/L	
250129O033	33	Room 207 Station 2-SK, Initial	0.001	0.009	mg/L	H
250129O034	34	Room 207 Station 3-SK, Initial	0.001	0.019	mg/L	H
250129O035	35	Room 207 Station 4-SK, Initial	0.001	0.015	mg/L	H
250129O036	36	Hallway by Room 203-WF, Initial	0.001	0.005	mg/L	
250129O037	37	Ice Machine in Storage Closet-IM, Initial	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

Laboratory Report

NYE Report #: 2500751-32492

March 3, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington UFSD; J. Taylor Finley Middle School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on February 28, 2025. New York Environmental analyzed the samples on March 03, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	27 Feb 2025
Date Received:	28 Feb 2025
Date Analyzed:	03 Mar 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250228J007	1A	Hallway By Girls Coach's Office-WF, Initial	0.001	0.019	mg/L	H
250228J008	1B	Hallway By Girls Coach's Office-WF, 15 Second Flush	0.001	0.003	mg/L	
250228J009	1C	Hallway By Girls Coach's Office-WF, 60 Second Flush	0.001	0.002	mg/L	
250228J010	2A	Kitchen Pot Filler By Stove-PF, Initial	0.001	0.001	mg/L	
250228J011	2B	Kitchen Pot Filler By Stove-PF, 15 Second Flush	0.001	NA	mg/L	
250228J012	2C	Kitchen Pot Filler By Stove-PF, 60 Second Flush	0.001	NA	mg/L	
250228J013	3A	Kitchen New Prep By Sanitizer-SK, Initial	0.001	0.004	mg/L	
250228J014	3B	Kitchen New Prep By Sanitizer-SK, 15 Second Flush	0.001	NA	mg/L	
250228J015	3C	Kitchen New Prep By Sanitizer-SK, 60 Second Flush	0.001	NA	mg/L	
250228J016	4A	Hallway by Room 112-WF, Initial	0.001	0.009	mg/L	H
250228J017	4B	Hallway by Room 112-WF, 15 Second Flush	0.001	0.002	mg/L	
250228J018	4C	Hallway by Room 112-WF, 60 Second Flush	0.001	0.001	mg/L	
250228J019	5A	Hallway by Room 123-WF, Initial	0.001	0.007	mg/L	H
250228J020	5B	Hallway by Room 123-WF, 15 Second Flush	0.001	0.002	mg/L	
250228J021	5C	Hallway by Room 123-WF, 60 Second Flush	0.001	0.001	mg/L	
250228J022	6A	Room 208 Station 1 -SK, Initial	0.001	0.019	mg/L	H
250228J023	6B	Room 208 Station 1 -SK, 15 Second Flush	0.001	0.004	mg/L	
250228J024	6C	Room 208 Station 1 -SK, 60 Second Flush	0.001	0.004	mg/L	
250228J025	7A	Room 208 Station 2-SK, Initial	0.001	0.026	mg/L	H
250228J026	7B	Room 208 Station 2-SK, 15 Second Flush	0.001	0.001	mg/L	
250228J027	7C	Room 208 Station 2-SK, 60 Second Flush	0.001	0.002	mg/L	
250228J028	8A	Room 208 Station 3-SK, Initial	0.001	0.026	mg/L	H
250228J029	8B	Room 208 Station 3-SK, 15 Second Flush	0.001	0.002	mg/L	
250228J030	8C	Room 208 Station 3-SK, 60 Second Flush	0.001	0.001	mg/L	
250228J031	9A	Room 208 Station 4-SK, Initial	0.001	0.040	mg/L	H
250228J032	9B	Room 208 Station 4-SK, 15 Second Flush	0.001	0.003	mg/L	



Date Collected:	27 Feb 2025
Date Received:	28 Feb 2025
Date Analyzed:	03 Mar 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250228J033	9C	Room 208 Station 4-SK, 60 Second Flush	0.001	0.002	mg/L	
250228J034	10A	Hallway By Room 207-WF, Initial	0.001	0.139	mg/L	E,H
250228J035	10B	Hallway By Room 207-WF, 15 Second Flush	0.001	0.120	mg/L	E,H
250228J036	10C	Hallway By Room 207-WF, 60 Second Flush	0.001	0.036	mg/L	H
250228J037	11A	Room 207 Station 2-SK, Initial	0.001	0.018	mg/L	H
250228J038	11B	Room 207 Station 2-SK, 15 Second Flush	0.001	0.003	mg/L	
250228J039	11C	Room 207 Station 2-SK, 60 Second Flush	0.001	<0.001	mg/L	
250228J040	12A	Room 207 Station 3-SK, Initial	0.001	0.036	mg/L	H
250228J041	12B	Room 207 Station 3-SK, 15 Second Flush	0.001	0.003	mg/L	
250228J042	12C	Room 207 Station 3-SK, 60 Second Flush	0.001	0.002	mg/L	
250228J043	13A	Room 207 Station 4-SK, Initial	0.001	0.014	mg/L	H
250228J044	13B	Room 207 Station 4-SK, 15 Second Flush	0.001	0.001	mg/L	
250228J045	13C	Room 207 Station 4-SK, 60 Second Flush	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

Appendix H

Huntington High School

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
0001-1	Custodial Bathroom	SK	N/A		1/28/2025				Sign
0002-1	Faculty Bathroom	SK	N/A		1/28/2025				Sign
0003-1	Faculty Men's Bathroom @A	SK	N/A		1/28/2025				Sign
0003-2	Faculty Men's Bathroom @B	SK	N/A		1/28/2025				Sign
0003-3	Faculty Men's Bathroom @ C	SK	N/A		1/28/2025				Sign
0004-1	Faculty Women's Bathroom @ A	SK	N/A		1/28/2025				Sign
0004-2	Faculty Women's Bathroom @ B	SK	N/A		1/28/2025				Sign
0004-3	Faculty Women's Bathroom @ C	SK	N/A		1/28/2025				Sign
0004-4	Faculty Women's Bathroom @ D	SK	N/A		1/28/2025				Sign
0005-1	Hallway by Building & Grounds Office	BF	App	<1.0	1/28/2025				
0005-2	Hallway by Building & Grounds Office	WF	App	<1.0	1/28/2025				
0006-1	Art Room 005 @A (Left)	SK	N/A		1/28/2025				Sign
0006-2	Art Room 005 @B (Right)	SK	N/A		1/28/2025				Sign
0007-1	Hallway by Custodial Entrance	WF	App	9.0	2/27/2025	3.0	4.0	2/27/2025	removed from Service; pending replacement
				7.0	1/28/2025				Removed from Service; pending remediation
0008-1	Room 011 @ A (Left)	SK	N/A		1/28/2025				Sign
0008-2	Room 011 @ B (Center)	SK	N/A		1/28/2025				Sign
0008-3	Room 011 @ C (Right)	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
0009-1	Room 012 @ A	SK	N/A		1/28/2025				Sign
0009-2	Room 012 @ B	SK	N/A		1/28/2025				Sign
0009-3	Room 012 @ C	SK	N/A		1/28/2025				Sign
0009-4	Room 012 Photo Lab	SK	N/A		1/28/2025				Sign
0010-1	Robotics Room 013	SK	N/A		1/28/2025				Sign
1001-1	Kitchen Handwash A	SK	N/A		1/28/2025				Sign
1001-2	Kitchen Prep @A	SK	App	3.0	2/28/2025				Remediation Complete
				8.0	1/28/2025				Removed from Service; pending remediation
1001-3	Kitchen Prep @B	SK	App	4.0	1/28/2025				
1001-4	Kitchen Handwash B	SK	N/A		1/28/2025				Sign
1001-5	Kitchen Dishwasher Station	SPY	N/A		1/28/2025				Sign
1001-6	Kitchen Sanitizer Station @A	SK	N/A		1/28/2025				Sign
1001-7	Kitchen Sanitizer Station @B	SK	N/A		1/28/2025				Sign
1001-8	Kitchen Sanitizer Station @C	SK	N/A		1/28/2025				Sign
1001-10	Kitchen Pot Filler by Stove	PF	N/A		1/28/2025				Sign
1001-11	Kitchen Pot Filler Spray by Oven	SPY	N/A		1/28/2025				Sign
1001-12	Kitchen Island	SK	App	7.0	2/27/2025	<1.0	<1.0		removed from Service; pending replacement
				7.0	1/28/2025				Removed from Service; pending remediation

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1001-13	North Serving Line	SK	N/A		1/28/2025				Sign
1001-14	South Serving Line	SK	N/A		1/28/2025				Sign
1001-15	South Serving Line Handwash	SK	N/A		1/28/2025				Sign
1002-1	Cafeteria B	WF	App	<1.0	1/28/2025				
1002-2	Cafeteria B	BF	App	<1.0	1/28/2025				
1003-1	Room 105	SK	N/A		1/28/2025				Sign
1004-1	Hallway by Room 105	WF	App		1/28/2025				Non-functionl; sampling required before returning to service
1005-1	Men's Bathroom by Room 105 Unit @ A	SK	N/A		1/28/2025				Sign
1005-2	Men's Bathroom by Room 105 Unit @ B	SK	N/A		1/28/2025				Sign
1005-3	Men's Bathroom by Room 105 Unit @ C	SK	N/A		1/28/2025				Sign
1005-4	Men's Bathroom by Room 105 Unit @ D	SK	N/A		1/28/2025				Sign
1006-1	Custodial Closet by Room 105	SS	N/A		1/28/2025				Sign
1007-1	Women's Bathroom by Room 105 Unit @A	SK	N/A		1/28/2025				Sign
1007-2	Women's Bathroom by Room 105 Unit @B	SK	N/A		1/28/2025				Sign
1007-3	Women's Bathroom by Room 105 Unit @C	SK	N/A		1/28/2025				Sign
1007-4	Women's Bathroom by Room 105 Unit @D	SK	N/A		1/28/2025				Sign
1008-1	Room 106 Unit @ A	SK	N/A		1/28/2025				Sign
1008-2	Room 106 Unit @ B	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1008-3	Room 106 Unit @ C	SK	N/A		1/28/2025				Sign
1009-1	Room 107 Unit @ A	SK	N/A		1/28/2025				Sign
1009-2	Room 107 Unit @ B	SK	N/A		1/28/2025				Sign
1010-1	Hallway by Room 107	WF	App	1.0	1/28/2025				
1011-1	Room 108	SK	N/A		1/28/2025				Sign
1012-1	Men's Faculty Bathroom by Room 108 @ A	SK	N/A		1/28/2025				Sign
1012-2	Men's Faculty Bathroom by Room 108 @ B	SK	N/A		1/28/2025				Sign
1013-1	Women's Faculty Bathroom by Room 108 @ A	SK	N/A		1/28/2025				Sign
1013-2	Women's Faculty Bathroom by Room 108 @ B	SK	N/A		1/28/2025				Sign
1014-1	Hallway by Room 103	WF	App	7.0	1/28/2025				Removed from Service; pending remediation
1015-1	Hallway by Room 101	WF	App	21.0	2/27/2025	11.0	4.0	2/27/2025	removed from Service; pending replacement
				14.0	1/28/2025				Removed from Service; pending remediation
1016-1	Room 161	SK	App	6.0	2/27/2025	2.0	2.0	2/27/2025	removed from Service; pending replacement
				31.0	1/28/2025				Sign
1018-1	Nurse's Office	SK	App	5.0	2/27/2025	<1.0	1.0	2/27/2025	Remediation Complete
				6.0	1/28/2025				Removed from Service; pending remediation
1018-2	Nurse's Office Bathroom	SK	N/A		1/28/2025				Sign
1018-3	Nurse's Waiting Room	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1019-1	Hallway by Room 109	WF	App	1.0	1/28/2025				
1020-1	Room 109 Teacher's Station	SK	N/A		1/28/2025				Sign
1020-2	Room 109 Counter 1 @ A	SK	N/A		1/28/2025				Sign
1020-3	Room 109 Counter 1 @ B	SK	N/A		1/28/2025				Sign
1020-4	Room 109 Counter 2 @ A	SK	N/A		1/28/2025				Sign
1020-5	Room 109 Counter 2 @ B	SK	N/A		1/28/2025				Sign
1021-1	Hallway by Room 110	WF	App	11.0	2/27/2025	2.0	1.0	2/27/2025	removed from Service; pending replacement
				9.0	1/28/2025				Removed from Service; pending remediation
1022-1	Room 110 Teacher's Station	SK	N/A		1/28/2025				Sign
1022-2	Room 110 Counter @ A	SK	N/A		1/28/2025				Sign
1022-3	Room 110 Counter @ B	SK	N/A		1/28/2025				Sign
1022-4	Room 110 Counter @ C	SK	N/A		1/28/2025				Sign
1022-5	Room 110 Table 1 @ A	SK	N/A		1/28/2025				Sign
1022-6	Room 110 Table 1 @ B	SK	N/A		1/28/2025				Sign
1022-7	Room 110 Table 2 @ A	SK	N/A		1/28/2025				Sign
1022-8	Room 110 Table 2 @ B	SK	N/A		1/28/2025				Sign
1022-9	Room 110 Table 3 @ A	SK	N/A		1/28/2025				Sign
1022-10	Room 110 Table 3 @ B	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1023-1	Room 110 Prep	SK	N/A		1/28/2025				Sign
1024-1	Prep Room 114A	SK	N/A		1/28/2025				Sign
1025-1	Custodial Closet by Room 114	SS	N/A		1/28/2025				Sign
1026-1	Room 114 Teacher's Station	SK	N/A		1/28/2025				Sign
1026-2	Room 114 Counter 1	SK	N/A		1/28/2025				Sign
1026-3	Room 114 Counter 2 @ A	SK	N/A		1/28/2025				Sign
1026-4	Room 114 Counter 2 @ B	SK	N/A		1/28/2025				Sign
1027-1	Room 113 Teacher's Station	SK	N/A		1/28/2025				Sign
1027-2	Room 113 Counter 1 @ A	SK	N/A		1/28/2025				Sign
1027-3	Room 113 Counter 1 @ B	SK	N/A		1/28/2025				Sign
1027-4	Room 113 Counter 2	SK	N/A		1/28/2025				Sign
1028-1	Room 112 Teacher's Station	SK	N/A		1/28/2025				Sign
1028-2	Room 112 Counter @ A	SK	N/A		1/28/2025				Sign
1028-3	Room 112 Counter @ B	SK	N/A		1/28/2025				Sign
1028-4	Room 112 Counter @ C	SK	N/A		1/28/2025				Sign
1028-5	Room 112 Table 1 @ A	SK	N/A		1/28/2025				Sign
1028-6	Room 112 Table 1 @ B	SK	N/A		1/28/2025				Sign
1028-7	Room 112 Table 2 @ A	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1028-8	Room 112 Table 2 @ B	SK	N/A		1/28/2025				Sign
1028-9	Room 112 Table 3 @ A	SK	N/A		1/28/2025				Sign
1028-10	Room 112 Table 3 @ B	SK	N/A		1/28/2025				Sign
1029-1	Hallway by Room 112	WF	App	21.0	1/28/2025				Removed from Service; pending remediation
1030-1	Faculty Dining Room	SK	App	2.0	1/28/2025				
1031-1	Hallway by Cafeteria B	WF	App	37.0	2/27/2025	16.0	6.0	2/27/2025	removed from Service; pending replacement
				9.0	1/28/2025				Removed from Service; pending remediation
1032-1	Hallway Ramp (East)	WF	App	18.0	2/27/2025	3.0	2.0	2/27/2025	removed from Service; pending replacement
				7.0	1/28/2025				Removed from Service; pending remediation
1033-1	Women's Bathroom by Room 143	SK	N/A		1/28/2025				Sign
1034-1	Custodial Closet by Room 143	SS	N/A		1/28/2025				Sign
1035-1	Room 143 Teacher's Station	SK	N/A		1/28/2025				Sign
1035-2	Room 143 Counter @ A	SK	N/A		1/28/2025				Sign
1035-3	Room 143 Counter @ B	SK	N/A		1/28/2025				Sign
1035-4	Room 143 Counter @ C	SK	N/A		1/28/2025				Sign
1035-5	Room 143 Table 1 @ A	SK	N/A		1/28/2025				Sign
1035-6	Room 143 Table 1 @ B	SK	N/A		1/28/2025				Sign
1035-7	Room 143 Table 2 @ A	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1035-8	Room 143 Table 2 @ B	SK	N/A		1/28/2025				Sign
1035-9	Room 143 Table 3 @ A	SK	N/A		1/28/2025				Sign
1035-10	Room 143 Table 3 @ B	SK	N/A		1/28/2025				Sign
1036-1	Prep Room 143/141 Counter @ A	SK	N/A		1/28/2025				Sign
1037-1	Room 141 Teacher's Station	SK	N/A		1/28/2025				Sign
1037-2	Room 141 Counter @ A	SK	N/A		1/28/2025				Sign
1037-4	Room 141 Counter @ C	SK	N/A		1/28/2025				Sign
1037-5	Room 141 Table 1 @ A	SK	N/A		1/28/2025				Sign
1037-6	Room 141 Table 1 @ B	SK	N/A		1/28/2025				Sign
1037-7	Room 141 Table 2 @ A	SK	N/A		1/28/2025				Sign
1037-8	Room 141 Table 2 @ B	SK	N/A		1/28/2025				Sign
1037-9	Room 141 Table 3 @ A	SK	N/A		1/28/2025				Sign
1037-10	Room 141 Table 3 @ B	SK	N/A		1/28/2025				Sign
1038-1	Room 144 Teacher's Station	SK	N/A		1/28/2025				Sign
1038-2	Room 144 Fume Hood	SK	N/A		1/28/2025				Sign
1038-3	Room 144 Counter	SK	N/A		1/28/2025				Sign
1038-4	Room 144 Pod 1 @ A	SK	N/A		1/28/2025				Sign
1038-5	Room 144 Pod 1 @ B	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1038-6	Room 144 Pod 2 @ A	SK	N/A		1/28/2025				Sign
1038-7	Room 144 Pod 2 @ B	SK	N/A		1/28/2025				Sign
1038-8	Room 144 Pod 3 @ A	SK	N/A		1/28/2025				Sign
1038-9	Room 144 Pod 3 @ B	SK	N/A		1/28/2025				Sign
1038-10	Room 144 Pod 4 @ A	SK	N/A		1/28/2025				Sign
1038-11	Room 144 Pod 4 @ B	SK	N/A		1/28/2025				Sign
1038-12	Room 144 Pod 5 @ A	SK	N/A		1/28/2025				Sign
1038-13	Room 144 Pod 5 @ B	SK	N/A		1/28/2025				Sign
1038-14	Room 144 Pod 6 @ A	SK	N/A		1/28/2025				Sign
1038-15	Room 144 Pod 6 @ B	SK	N/A		1/28/2025				Sign
1039-1	Prep Room 144 / 145	SK	N/A		1/28/2025				Sign
1040-1	Room 145 Teacher's Station	SK	N/A		1/28/2025				Sign
1040-2	Room 145 Counter	SK	N/A		1/28/2025				Sign
1040-3	Room 145 Fume Hood	SK	N/A		1/28/2025				Sign
1040-4	Room 145 Pod 1 @ A	SK	N/A		1/28/2025				Sign
1040-5	Room 145 Pod 1 @ B	SK	N/A		1/28/2025				Sign
1040-6	Room 145 Pod 2 @ A	SK	N/A		1/28/2025				Sign
1040-7	Room 145 Pod 2 @ B	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1040-8	Room 145 Pod 3 @ A	SK	N/A		1/28/2025				Sign
1040-9	Room 145 Pod 3 @ B	SK	N/A		1/28/2025				Sign
1040-10	Room 145 Pod 4 @ A	SK	N/A		1/28/2025				Sign
1040-11	Room 145 Pod 4 @ B	SK	N/A		1/28/2025				Sign
1040-12	Room 145 Pod 5 @ A	SK	N/A		1/28/2025				Sign
1040-13	Room 145 Pod 5 @ B	SK	N/A		1/28/2025				Sign
1040-14	Room 145 Pod 6 @ A	SK	N/A		1/28/2025				Sign
1040-15	Room 145 Pod 6 @ B	SK	N/A		1/28/2025				Sign
1041-1	Hallway by Room 145	WF	App		1/28/2025				Non-functionl; sampling required before returning to service
1042-1	Room 146 Teacher's Station	SK	N/A		1/28/2025				Sign
1042-2	Room 146 Counter	SK	N/A		1/28/2025				Sign
1042-3	Room 146 Table 1 @ A	SK	N/A		1/28/2025				Sign
1042-4	Room 146 Table 1 @ B	SK	N/A		1/28/2025				Sign
1042-5	Room 146 Table 2 @ A	SK	N/A		1/28/2025				Sign
1042-6	Room 146 Table 2 @ B	SK	N/A		1/28/2025				Sign
1042-7	Room 146 Table 3 @ A	SK	N/A		1/28/2025				Sign
1042-8	Room 146 Table 3 @ B	SK	N/A		1/28/2025				Sign
1042-9	Room 146 Table 4	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1042-10	Room 146 Table 5 @ A	SK	N/A		1/28/2025				Sign
1042-11	Room 146 Table 5 @ B	SK	N/A		1/28/2025				Sign
1042-12	Room 146 Table 6 @ A	SK	N/A		1/28/2025				Sign
1042-13	Room 146 Table 6 @ B	SK	N/A		1/28/2025				Sign
1042-14	Room 146 Table 7 @ A	SK	N/A		1/28/2025				Sign
1042-15	Room 146 Table 7 @ B	SK	N/A		1/28/2025				Sign
1043-1	Prep Room 146 Counter 1	SK	N/A		1/28/2025				Sign
1043-2	Prep Room 146 Counter 2	SK	N/A		1/28/2025				Sign
1044-1	Hallway by Room 150	WF	App		1/28/2025				Non-functionl; sampling required before returning to service
1045-1	Room 148 Teacher's Station	SK	N/A		1/28/2025				Sign
1045-2	Room 148 Eye Wash Station	SK	N/A		1/28/2025				Sign
1046-1	Room 150 Teacher's Station	SK	N/A		1/28/2025				Sign
1046-2	Room 150 Counter 1	SK	N/A		1/28/2025				Sign
1046-3	Room 150 Counter 2	SK	N/A		1/28/2025				Sign
1047-1	Hallway by Room 141	WF	App		1/28/2025				Non-functionl; sampling required before returning to service
1048-1	Men's Faculty Bathroom Across from Elevator	SK	N/A		1/28/2025				Sign
1048-2	Men's Faculty Bathroom Across from Elevator	SK	N/A		1/28/2025				Sign
1049-1	Hallway by Room 132 (Security Office)	WF	App	31.0	1/28/2025				Removed from Service

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1050-1	Men's Bathroom by Room 123 Unit @ A	SK	N/A		1/28/2025				Sign
1050-2	Men's Bathroom by Room 123 Unit @ B	SK	N/A		1/28/2025				Sign
1050-3	Men's Bathroom by Room 123 Unit @ C	SK	N/A		1/28/2025				Sign
1050-4	Men's Bathroom by Room 123 Unit @ D	SK	N/A		1/28/2025				Sign
1051-1	Custodial Closet by Room 123	SS	N/A		1/28/2025				Sign
1052-1	Women's Bathroom by Room 123 Unit @ A	SK	N/A		1/28/2025				Sign
1052-2	Women's Bathroom by Room 123 Unit @ B	SK	N/A		1/28/2025				Sign
1052-3	Women's Bathroom by Room 123 Unit @ C	SK	N/A		1/28/2025				Sign
1052-4	Women's Bathroom by Room 123 Unit @ D	SK	N/A		1/28/2025				Sign
1053-1	Hallway by Room 123	WF	App	1.0	1/28/2025				0
1054-1	Library Office (Room 110)	SK	App	4.0	1/28/2025				0
1055-1	Hallway by Library Office	WF	App	2.0	1/28/2025				0
1056-1	Women's Bathroom by Room 122 @ A	SK	N/A		1/28/2025				Sign
1056-2	Women's Bathroom by Room 122 @ B	SK	N/A		1/28/2025				Sign
1057-1	Men's Bathroom by Room 122 @ A	SK	N/A		1/28/2025				Sign
1057-2	Men's Bathroom by Room 122 @ B	SK	N/A		1/28/2025				Sign
1058-1	Custodial Closet in Girl's Locker Room	SS	N/A		1/28/2025				Sign
1058-2	Girl's Locker Room @ A	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
1058-3	Girl's Locker Room @ B	SK	N/A		1/28/2025				Sign
1059-1	Girl's Coach's Office Bathroom	SK	N/A		1/28/2025				Sign
1059-2	Girl's Coach's Office	WF	N/A		1/28/2025				Sign
1060-1	Gym Lobby	WF	App	<1.0	1/28/2025				0
1060-2	Gym Lobby	BF	App	<1.0	1/28/2025				0
1061-1	Boy's Coach's Office Bathroom	SK	N/A		1/28/2025				Sign
1062-1	Girl's Sports Locker Room Bathroom	WF	App	20.0	2/27/2025	26.0	7.0		removed from Service; pending replacement
				12.0	1/28/2025				Removed from Service; pending remediation
1063-1	Custodial Closet in Girl's Sports Locker Room	SS	N/A		1/28/2025				Sign
1063-2	Girl's Sports Locker Room Bathroom	SK	N/A		1/28/2025				Sign
1066-1	Boy's Lower Locker Room Bathroom @A	SK	N/A		1/28/2025				Sign
1066-2	Boy's Lower Locker Room Bathroom @B	SK	N/A		1/28/2025				Sign
1067-1	Boy's Lower Locker Room Vestibule	BF	App	<1.0	1/28/2025				
1067-2	Boy's Lower Locker Room Vestibule	WF	App	<1.0	1/28/2025				
2001-1	Men's Faculty Bathroom by 232A @ A	SK	N/A		1/28/2025				Sign
2001-2	Men's Faculty Bathroom by 232A @ B	SK	N/A		1/28/2025				Sign
2002-1	Teacher's Faculty Lounge	SK	App	2.0	1/28/2025				0
2003-1	Hallway by Teacher's Faculty Lounge	WF	App	4.0	1/28/2025				0

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2004-1	Women's Faculty Bathroom 261B @ A	SK	N/A		1/28/2025				Sign
2004-2	Women's Faculty Bathroom 261B @ B	SK	N/A		1/28/2025				Sign
2005-1	Hallway by Room 219	WF	App	3.0	1/28/2025				0
2006-1	Custodial Closet by Room 219	SS	N/A		1/28/2025				Sign
2007-1	Hallway by Room 228	WF	App	24.0	2/27/2025	26.0	7.0	2/27/2025	removed from Service; pending replacement
				17.0	1/28/2025				Removed from Service; pending remediation
2008-1	Faculty Bathroom-2nd Floor @ A	SK	N/A		1/28/2025				Sign
2008-2	Faculty Bathroom-2nd Floor @ B	SK	N/A		1/28/2025				Sign
2008-3	Faculty Bathroom-2nd Floor @ C	SK	N/A		1/28/2025				Sign
2008-4	Faculty Bathroom-2nd Floor @ D	SK	N/A		1/28/2025				Sign
2009-1	Hall by 241	WF	App	23.0	1/28/2025				Removed from Service; pending remediation
2010-1	Hallway by Room 251	WF	App	39.0	2/27/2025	26.0	18.0	2/27/2025	removed from Service; pending replacement
				14.0	1/28/2025				Removed from Service; pending remediation
2011-1	Custodial Closet by Room 244	SS	N/A		1/28/2025				Sign
2012-1	Women's Faculty Bathroom by Room 244	SK	N/A		1/28/2025				Sign
2013-1	Hallway Ramp-2nd Floor	WF	App	2.0	1/28/2025				0
2014-1	Women's Faculty BR by 2nd Floor Ramp @ A	SK	N/A		1/28/2025				Sign
2014-2	Women's Faculty BR by 2nd Floor Ramp @ B	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2014-3	Women's Faculty BR by 2nd Floor Ramp @ C	SK	N/A		1/28/2025				Sign
2015-1	Hallway by Room 208	WF	App	36.0	2/27/2025	43.0	49.0	2/27/2025	removed from Service; pending replacement
				9.0	1/28/2025				Removed from Service; pending remediation
2016-1	Room 208 Teacher's Station	SK	N/A		1/28/2025				Sign
2016-2	Room 208 Counter @ A	SK	N/A		1/28/2025				Sign
2016-3	Room 208 Counter @ B	SK	N/A		1/28/2025				Sign
2016-4	Room 208 Counter @ C	SK	N/A		1/28/2025				Sign
2016-5	Room 208 Table 1 @ A	SK	N/A		1/28/2025				Sign
2016-6	Room 208 Table 1 @ B	SK	N/A		1/28/2025				Sign
2016-7	Room 208 Table 1 @ C	SK	N/A		1/28/2025				Sign
2016-8	Room 208 Table 1 @ D	SK	N/A		1/28/2025				Sign
2016-9	Room 208 Table 2 @ A	SK	N/A		1/28/2025				Sign
2016-10	Room 208 Table 2 @ B	SK	N/A		1/28/2025				Sign
2016-11	Room 208 Table 2 Fume Hood	SK	N/A		1/28/2025				Sign
2016-12	Room 208 Table 2 @ C	SK	N/A		1/28/2025				Sign
2016-13	Room 208 Table 2 @ D	SK	N/A		1/28/2025				Sign
2016-14	Room 208 Table 3 @ A	SK	N/A		1/28/2025				Sign
2016-15	Room 208 Table 3 @ B	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2016-16	Room 208 Table 3 @ C	SK	N/A		1/28/2025				Sign
2016-17	Room 208 Table 3 @ D	SK	N/A		1/28/2025				Sign
2017-1	Prep Room 208/209	SK	N/A		1/28/2025				Sign
2018-1	Room 209 Teacher's Station	SK	N/A		1/28/2025				Sign
2018-2	Room 209 Counter @ A	SK	N/A		1/28/2025				Sign
2018-3	Room 209 Counter @ B	SK	N/A		1/28/2025				Sign
2018-4	Room 209 Counter @ C	SK	N/A		1/28/2025				Sign
2018-5	Room 209 Table 1 @ A	SK	N/A		1/28/2025				Sign
2018-6	Room 209 Table 1 @ B	SK	N/A		1/28/2025				Sign
2018-7	Room 209 Table 1 @ C	SK	N/A		1/28/2025				Sign
2018-8	Room 209 Table 1 @ D	SK	N/A		1/28/2025				Sign
2018-9	Room 209 Table 2 @ A	SK	N/A		1/28/2025				Sign
2018-10	Room 209 Table 2 @ B	SK	N/A		1/28/2025				Sign
2018-11	Room 209 Fume Hood	SK	N/A		1/28/2025				Sign
2018-12	Room 209 Table 2 @ C	SK	N/A		1/28/2025				Sign
2018-13	Room 209 Table 2 @ D	SK	N/A		1/28/2025				Sign
2018-14	Room 209 Table 3 @ A	SK	N/A		1/28/2025				Sign
2018-15	Room 209 Table 3 @ B	SK	N/A		1/28/2025				Sign

Fixture #	Sample Location	Fixture Type	App or N/A	Latest 1 st Draw Results (ppb)	Latest 1st Draw Sampling Date	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
2018-16	Room 209 Table 3 @ C	SK	N/A		1/28/2025				Sign
2018-17	Room 209 Table 3 @ D	SK	N/A		1/28/2025				Sign
2019-1	Men's Bathroom by Room 209 @ A	SK	N/A		1/28/2025				Sign
2019-2	Men's Bathroom by Room 209 @ B	SK	N/A		1/28/2025				Sign
2019-3	Men's Bathroom by Room 209 @ C	SK	N/A		1/28/2025				Sign
2019-4	Men's Bathroom by Room 209 @ D	SK	N/A		1/28/2025				Sign
2020-1	Custodial Closet by Room 209	SS	N/A		1/28/2025				Sign
2021-1	Hallway by Room 203	WF	App	12.0	2/27/2025	4.0	1.0	2/27/2025	removed from Service; pending replacement
				8.0	1/28/2025				Removed from Service; pending remediation
2022-1	Women's Bathroom by Room 203 @ A	SK	N/A		1/28/2025				Sign
2022-2	Women's Bathroom by Room 203 @ B	SK	N/A		1/28/2025				Sign
2022-3	Women's Bathroom by Room 203 @ C	SK	N/A		1/28/2025				Sign
2022-4	Women's Bathroom by Room 203 @ D	SK	N/A		1/28/2025				Sign
2023-1	Hallway by Room 202	WF	App	<1.0	1/28/2025				0
2023-2	Hallway by Room 202	BF	App	<1.0	1/28/2025				0
2024-1	Room 216A	SK	App	7.0	2/27/2025	2.0	<1.0	2/27/2025	removed from Service; pending replacement
				6.0	1/28/2025				Removed from Service; pending remediation

Laboratory Report

NYE Report #: 2500757-32498

March 4, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington UFSD; Huntington High School

Dear Project Manager,


Enclosed is the Laboratory Analytical Report for potable water sample(s) received on February 28, 2025. New York Environmental analyzed the samples on March 03, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	27 Feb 2025
Date Received:	28 Feb 2025
Date Analyzed:	03 Mar 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250228K046	1A	Hallway By Custodial Entrance-WF, Initial	0.001	0.009	mg/L	H
250228K047	1B	Hallway By Custodial Entrance-WF, 15 Second Flush	0.001	0.003	mg/L	
250228K048	1C	Hallway By Custodial Entrance-WF, 60 Second Flush	0.001	0.004	mg/L	
250228K049	2A	Kitchen Prep @ A-SK, Initial	0.001	0.003	mg/L	
250228K050	2B	Kitchen Prep @ A-SK, 15 Second Flush	0.001	NA	mg/L	
250228K051	2C	Kitchen Prep @ A-SK, 60 Second Flush	0.001	NA	mg/L	
250228K052	3A	Kitchen Island-SK, Initial	0.001	0.007	mg/L	H
250228K053	3B	Kitchen Island-SK, 15 Second Flush	0.001	<0.001	mg/L	
250228K054	3C	Kitchen Island-SK, 60 Second Flush	0.001	<0.001	mg/L	
250228K055	4A	Hallway by Cafeteria B-WF, Initial	0.001	0.037	mg/L	H
250228K056	4B	Hallway by Cafeteria B-WF, 15 Second Flush	0.001	0.016	mg/L	H
250228K057	4C	Hallway by Cafeteria B-WF, 60 Second Flush	0.001	0.006	mg/L	H
250228K058	5A	Hallway by Room 101-WF, Initial	0.001	0.024	mg/L	H
250228K059	5B	Hallway by Room 101-WF, 15 Second Flush	0.001	0.011	mg/L	H
250228K060	5C	Hallway by Room 101-WF, 60 Second Flush	0.001	0.004	mg/L	
250228K061	6A	Room 161-SK, Initial	0.001	0.006	mg/L	H
250228K062	6B	Room 161-SK, 15 Second Flush	0.001	0.002	mg/L	
250228K063	6C	Room 161-SK, 60 Second Flush	0.001	0.002	mg/L	
250228K064	7A	Nurse's Office-SK, Initial	0.001	0.005	mg/L	
250228K065	7B	Nurse's Office-SK, 15 Second Flush	0.001	<0.001	mg/L	
250228K066	7C	Nurse's Office-SK, 60 Second Flush	0.001	0.001	mg/L	
250228K067	8A	Hallway By Room 110-WF, Initial	0.001	0.011	mg/L	H
250228K068	8B	Hallway By Room 110-WF, 15 Second Flush	0.001	0.002	mg/L	
250228K069	8C	Hallway By Room 110-WF, 60 Second Flush	0.001	0.001	mg/L	
250228K070	9A	Hallway Ramp (East)-WF, Initial	0.001	0.018	mg/L	H
250228K071	9B	Hallway Ramp (East)-WF, 15 Second Flush	0.001	0.003	mg/L	

Date Collected:	27 Feb 2025
Date Received:	28 Feb 2025
Date Analyzed:	03 Mar 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250228K072	9C	Hallway Ramp (East)-WF, 60 Second Flush	0.001	0.002	mg/L	
250228K073	10A	Girls Sports Locker Room Bathroom-WF, Initial	0.001	0.020	mg/L	H
250228K074	10B	Girls Sports Locker Room Bathroom-WF, 15 Second Flush	0.001	0.026	mg/L	H
250228K075	10C	Girls Sports Locker Room Bathroom-WF, 60 Second Flush	0.001	0.007	mg/L	H
250228K076	11A	Hallway by Room 228-WF, Initial	0.001	0.024	mg/L	H
250228K077	11B	Hallway by Room 228-WF, 15 Second Flush	0.001	0.016	mg/L	H
250228K078	11C	Hallway by Room 228-WF, 60 Second Flush	0.001	0.009	mg/L	H
250228K079	12A	Hallway by Room 251-WF, Initial	0.001	0.039	mg/L	H
250228K080	12B	Hallway by Room 251-WF, 15 Second Flush	0.001	0.026	mg/L	H
250228K081	12C	Hallway by Room 251-WF, 60 Second Flush	0.001	0.018	mg/L	H
250228K082	13A	Hallway by Room 208-WF, Initial	0.001	0.036	mg/L	H
250228K083	13B	Hallway by Room 208-WF, 15 Second Flush	0.001	0.043	mg/L	H
250228K084	13C	Hallway by Room 208-WF, 60 Second Flush	0.001	0.049	mg/L	H
250228K085	14A	Hallway by Room 203-WF, Initial	0.001	0.012	mg/L	H
250228K086	14B	Hallway by Room 203-WF, 15 Second Flush	0.001	0.004	mg/L	
250228K087	14C	Hallway by Room 203-WF, 60 Second Flush	0.001	0.001	mg/L	
250228K088	15A	Room 216A-SK, Initial	0.001	0.007	mg/L	H
250228K089	15B	Room 216A-SK, 15 Second Flush	0.001	0.002	mg/L	
250228K090	15C	Room 216A-SK, 60 Second Flush	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.



Laboratory Report

NYE Report #: 2500360-32220

January 31, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington UFSD; Huntington High School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on January 29, 2025. New York Environmental analyzed the samples on January 31, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	28 Jan 2025
Date Received:	29 Jan 2025
Date Analyzed:	31 Jan 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250129O054	1	Hallway by Building & Grounds Office-BF, Initial	0.001	<0.001	mg/L	
250129O055	2	Hallway by Building & Grounds Office-WF, Initial	0.001	<0.001	mg/L	
250129O056	3	Hallway by Custodial Entrance-WF, Initial	0.001	0.007	mg/L	H
250129O057	4	Kitchen Prep @A-SK, Initial	0.001	0.008	mg/L	H
250129O058	5	Kitchen Prep @B-SK, Initial	0.001	0.004	mg/L	
250129O059	6	Kitchen Island-SK, Initial	0.001	0.007	mg/L	H
250129O060	7	Cafeteria B-WF, Initial	0.001	<0.001	mg/L	
250129O061	8	Cafeteria B-BF, Initial	0.001	<0.001	mg/L	
250129O062	9	Hallway by Room 107-WF, Initial	0.001	0.001	mg/L	
250129O063	10	Hallway by Room 103-WF, Initial	0.001	0.007	mg/L	H
250129O064	11	Hallway by Room 101-WF, Initial	0.001	0.014	mg/L	H
250129O065	12	Room 161-SK, Initial	0.001	0.031	mg/L	H
250129O066	13	Nurse's Office-SK, Initial	0.001	0.006	mg/L	H
250129O067	14	Hallway by Room 109-WF, Initial	0.001	0.001	mg/L	
250129O068	15	Hallway by Room 110-WF, Initial	0.001	0.009	mg/L	H
250129O069	16	Hallway by Room 112-WF, Initial	0.001	0.021	mg/L	H
250129O070	17	Faculty Dining Room-SK, Initial	0.001	0.002	mg/L	
250129O071	18	Hallway by Cafeteria B-WF, Initial	0.001	0.009	mg/L	H
250129O072	19	Hallway Ramp (East)-WF, Initial	0.001	0.007	mg/L	H
250129O073	20	Hallway by Room 132 (Security Office)-WF, Initial	0.001	0.031	mg/L	H
250129O074	21	Hallway by Room 123-WF, Initial	0.001	0.001	mg/L	
250129O075	22	Library Office (Room 110)-SK, Initial	0.001	0.004	mg/L	
250129O076	23	Hallway by Library Office-WF, Initial	0.001	0.002	mg/L	
250129O077	24	Gym Lobby-WF, Initial	0.001	<0.001	mg/L	
250129O078	25	Gym Lobby-BF, Initial	0.001	<0.001	mg/L	
250129O079	26	Girl's Sports Locker Room Bathroom -WF, Initial	0.001	0.012	mg/L	H

Date Collected:	28 Jan 2025
Date Received:	29 Jan 2025
Date Analyzed:	31 Jan 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250129O080	27	Boy's Lower Locker Room Vestibule-BF, Initial	0.001	<0.001	mg/L	
250129O081	28	Boy's Lower Locker Room Vestibule-WF, Initial	0.001	<0.001	mg/L	
250129O082	29	Teacher's Faculty Lounge-SK, Initial	0.001	0.002	mg/L	
250129O083	30	Hallway by Teacher's Faculty Lounge-WF, Initial	0.001	0.004	mg/L	
250129O084	31	Hallway by Room 219-WF, Initial	0.001	0.003	mg/L	
250129O085	32	Hallway by Room 228-WF, Initial	0.001	0.017	mg/L	H
250129O086	33	Hallway by Room 241-WF, Initial	0.001	0.023	mg/L	H
250129O087	34	Hallway by Room 251-WF, Initial	0.001	0.014	mg/L	H
250129O088	35	Hallway Ramp-2nd Floor-WF, Initial	0.001	0.002	mg/L	
250129O089	36	Hallway by Room 208-WF, Initial	0.001	0.009	mg/L	H
250129O090	37	Hallway by Room 203-SK, Initial	0.001	0.008	mg/L	H
250129O091	38	Hallway by Room 202-WF, Initial	0.001	<0.001	mg/L	
250129O092	39	Hallway by Room 202-BF, Initial	0.001	<0.001	mg/L	
250129O093	40	Room 216A-SK, Initial	0.001	0.006	mg/L	H

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

Sample Location	Fixture Type	App or N/A	Prior 1 st Draw Results (ppb)	Latest 1 st Draw Sampling Date	Latest 1 st Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Flush Sampling Date	Remarks
Flower Hill Primary School									
Kitchen Prep Sink - Left	SK	App	6.0	1/31/2025					Removed from Service; Pending Remediation
Room 16	SK	App	6.0	1/31/2025					Removed from Service; Pending Remediation
Jefferson Primary School									
Room 14 Bathroom	SK	App	9.0	1/31/2025					Removed from Service; Pending Remediation
Hallway by Room 24	WF	App	10.0	1/31/2025					Removed from Service; Pending Remediation
Southdown Primary School									
Washington Primary School									
Kitchen Dishwash Station	SK	App	9.0	1/30/2025	2.0			5/2/2025	Remediation Complete
Kitchen Dishwash Station - 2 Bay - Left	SK	App	9.0	1/30/2025	<0.1			5/2/2025	Remediation Complete
Jack Abrams STEM Magnet School									
Kitchen Food Prep @A	SK	App	8.0	1/29/2025					Removed from Service; Pending Remediation
Kitchen New Prep Sink by Pot Shelf	SK	App	8.0	1/29/2025					Removed from Service; Pending Remediation
Kitchen Potfiller North - Right	PF	App	9.0	1/29/2025					Removed from Service; Pending Remediation
Kitchen Potfiller South - Left	PF	App	6.0	1/29/2025					Removed from Service; Pending Remediation
STEM Director K-12 Room 202A	SK	App	25.0	1/29/2025	15.0	1.0	<1.0	5/2/2025	Removed from Service; Pending Remediation
Administration Breakroom	SK	App	14.0	1/29/2025	12.0	<1.0	<1.0	5/2/2025	Removed from Service; Pending Remediation
Transportation	SK	App	7.0	1/29/2025	3.0			5/2/2025	Remediation Complete

Human Resources	SK	App	6.0	1/29/2025	3.0			5/2/2025	Remediation Complete
Woodhull Intermediate School									
J. Taylor Finley Middle School									
Kitchen New Prep by Sanitizer	SK	App	8.0	1/28/2025					Removed from Service; Pending Remediation
Kitchen Pot Filler by Stove	PF	App	8.0	1/28/2025					Removed from Service; Pending Remediation
Hallway by Girls Coach's Office	WF	App	8.0	1/28/2025					Removed from Service; Pending Remediation
Hallway by Room 123	WF	App	8.0	1/28/2025					Removed from Service; Pending Remediation
Hallway by Room 112	WF	App	9.0	1/28/2025					Removed from Service; Pending Remediation
Room 208 Station 1	SK	App	10.0	1/28/2025	6.0	2.0	3.0	5/2/2025	Removed from Service; Pending Remediation
Room 208 Station 2	SK	App	9.0	1/28/2025	9.0	<1.0	<1.0	5/2/2025	Removed from Service; Pending Remediation
Room 208 Station 3	SK	App	12.0	1/28/2025	6.0	1.0	<1.0	5/2/2025	Removed from Service; Pending Remediation
Room 208 Station 4	SK	App	13.0	1/28/2025	13.0	1.0	<1.0	5/2/2025	Removed from Service; Pending Remediation
Hallway by Room 207	WF	App	7.0	1/28/2025					Removed from Service; Pending Remediation
Room 207 Station 2	SK	App	9.0	1/28/2025	5.0			5/2/2025	Remediation Complete
Room 207 Station 3	SK	App	19.0	1/28/2025	33.0	2.0	1.0	5/2/2025	Removed from Service; Pending Remediation
Room 207 Station 4	SK	App	15.0	1/28/2025	7.0	1.0	<1.0	5/2/2025	Removed from Service; Pending Remediation
Huntington High School									
Hallway by Custodial Entrance	WF	App	7.0	1/28/2025					Removed from Service; Pending Remediation
Kitchen Prep @ A	SK	App	8.0	1/28/2025					Removed from Service; Pending Remediation
Kitchen Island	SK	App	7.0	1/28/2025					Removed from Service; Pending Remediation
Hallway by Room 103	WF	App	7.0	1/28/2025					Removed from Service; Pending Remediation
Hallway by Room 101	WF	App	14.0	1/28/2025					Removed from Service; Pending Remediation

Room 161	SK	App	31.0	1/28/2025	16.0	2.0	2.0	5/2/2025	Removed from Service; Pending Remediation
Nurse's Office	SK	App	6.0	1/28/2025					Removed from Service; Pending Remediation
Hallway by Room 110	WF	App	9.0	1/28/2025					Removed from Service; Pending Remediation
Hallway by Room 112	WF	App	21.0	1/28/2025					Removed from Service; Pending Remediation
Hallway by Cafeteria B	WF	App	9.0	1/28/2025					Removed from Service; Pending Remediation
Hallway Ramp (East)	WF	App	7.0	1/28/2025					Removed from Service; Pending Remediation
Girl's Sports Locker Room Bathroom	WF	App	12.0	1/28/2025					Removed from Service; Pending Remediation
Hallway by Room 228	WF	App	17.0	1/28/2025					Removed from Service; Pending Remediation
Hallway by Room 241	WF	App	23.0	1/28/2025					Removed from Service; Pending Remediation
Hallway by Room 251	WF	App	14.0	1/28/2025					Removed from Service; Pending Remediation
Hallway by Room 208	WF	App	9.0	1/28/2025					Removed from Service; Pending Remediation
Hallway by Room 203	WF	App	8.0	1/28/2025					Removed from Service; Pending Remediation
Room 216A	SK	App	6.0	1/28/2025	11.0	1.0	<0.1	5/2/2025	Removed from Service; Pending Remediation
Hose Bib in Front of Building	HB	App	2.0	5/2/2025					Remediation Complete
Field House	SK	App	3.0	5/2/2025					Remediation Complete
Field House	WF	App							Nonfunctional at Time of Sampling
Key									
WF-Water Fountain									
SK-Sink									
App-currently considered an applicable/potable source									

Laboratory Report

NYE Report #: 2501950-33227

May 6, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington Ufsd; Huntington Hs

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on May 02, 2025. New York Environmental analyzed the samples on May 06, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	02 May 2025
Date Received:	02 May 2025
Date Analyzed:	06 May 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250502P014	3A	Room 161 'A' - SK, Initial	0.001	0.016	mg/L	H
250502P015	3B	Room 161 'B' - SK, 15 Second Flush	0.001	0.002	mg/L	
250502P016	3C	Room 161 'C' - SK, 60 Second Flush	0.001	0.002	mg/L	
250502P017	1A	Room 216A 'A' - SK, Initial	0.001	0.011	mg/L	H
250502P018	1B	Room 216A 'B' - SK, 15 Second Draw	0.001	0.001	mg/L	
250502P019	1C	Room 216A 'C' - SK, 60 Second Draw	0.001	<0.001	mg/L	
250502P020	2A	Hose Bib in Front of Building - HB, Initial	0.001	0.002	mg/L	
250502P021	2B	Hose Bib in Front of Building - HB, 15 Second Draw	0.001	NA	mg/L	
250502P022	2C	Hose Bib in Front of Building - HB, 60 Second Draw	0.001	NA	mg/L	
2505060611	4A	Field House - Sk, Initial	0.001	0.003	mg/L	
250506061A	4B	Field House - Sk, 15 Second Draw	0.001	NA	mg/L	
250506061B	4C	Field House - Sk, 60 Second Draw	0.001	NA	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.

Laboratory Report

NYE Report #: 2501952-33229

May 6, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington Ufs; J. Taylor Finley Middle School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on May 02, 2025. New York Environmental analyzed the samples on May 06, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	02 May 2025
Date Received:	02 May 2025
Date Analyzed:	06 May 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250502P035	4A	Room 208 Station 1 'A' - SK, Initial	0.001	0.006	mg/L	H
250502P036	4B	Room 208 Station 1 'B' - SK, 15 Second Draw	0.001	0.002	mg/L	
250502P037	4C	Room 208 Station 1 'C' - SK, 60 Second Draw	0.001	0.003	mg/L	
250502P038	5A	Room 208 Station 2 'A' - SK, Initial	0.001	0.009	mg/L	H
250502P039	5B	Room 208 Station 2 'B' - SK, 15 Second Draw	0.001	<0.001	mg/L	
250502P040	5C	Room 208 Station 2 'C' - SK, 60 Second Draw	0.001	<0.001	mg/L	
250502P041	6A	Room 208 Station 3 'A' - SK, Initial	0.001	0.006	mg/L	H
250502P042	6B	Room 208 Station 3 'B' - SK, 15 Second Draw	0.001	0.001	mg/L	
250502P043	6C	Room 208 Station 3 'C' - SK, 60 Second Draw	0.001	<0.001	mg/L	
250502P044	7A	Room 208 Station 4 'A' - SK, Initial	0.001	0.013	mg/L	H
250502P045	7B	Room 208 Station 4 'B' - SK, 15 Second Draw	0.001	0.001	mg/L	
250502P046	7C	Room 208 Station 4 'C' - SK, 60 Second Draw	0.001	<0.001	mg/L	
250502P047	1A	Room 207 Station 2 'A' - SK, Initial	0.001	0.005	mg/L	
250502P048	1B	Room 207 Station 2 'B' - SK, 15 Second Draw	0.001	NA	mg/L	
250502P049	1C	Room 207 Station 2 'C' - SK, 60 Second Draw	0.001	NA	mg/L	
250502P050	2A	Room 207 Station 3 'A' - SK, Initial	0.001	0.033	mg/L	H
250502P051	2B	Room 207 Station 3 'B' - SK, 15 Second Draw	0.001	0.002	mg/L	
250502P052	2C	Room 207 Station 3 'C' - SK, 60 Second Draw	0.001	0.001	mg/L	
250502P053	3A	Room 207 Station 4 'A' - SK, Initial	0.001	0.007	mg/L	H
250502P054	3B	Room 207 Station 4 'B' - SK, 15 Second Draw	0.001	0.001	mg/L	
250502P055	3C	Room 207 Station 4 'C' - SK, 60 Second Draw	0.001	<0.001	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

H: Sample result exceeds applicable regulatory limit.



Laboratory Report

NYE Report #: 2501951-33228

May 6, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington Ufsd; Jack Abrams Stem Magnet School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on May 02, 2025. New York Environmental analyzed the samples on May 06, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	02 May 2025
Date Received:	02 May 2025
Date Analyzed:	06 May 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250502P023	1A	STEAM Director K-12 Room 202A 'A'-SK, Initial	0.001	0.015	mg/L	H
250502P024	1B	STEAM Director K-12 Room 202A 'B'-SK, 15 Second Draw	0.001	0.001	mg/L	
250502P025	1C	STEAM Director K-12 Room 202A 'C'-SK, 60 Second Draw	0.001	<0.001	mg/L	
250502P026	2A	Admin Breakroom 'A'-SK, Initial	0.001	0.012	mg/L	H
250502P027	2B	Admin Breakroom 'B'-SK, 15 Second Draw	0.001	<0.001	mg/L	
250502P028	2C	Admin Breakroom 'C'-SK, 60 Second Draw	0.001	<0.001	mg/L	
250502P029	3A	Transportation 'A'-SK, Initial	0.001	0.003	mg/L	
250502P030	3B	Transportation 'B'-SK, 15 Second Draw	0.001	NA	mg/L	
250502P031	3C	Transportation 'C'-SK, 60 Second Draw	0.001	NA	mg/L	
250502P032	4A	Human Resources 'A'-SK, Initial	0.001	0.003	mg/L	
250502P033	4B	Human Resources 'B'-SK, 15 Second Draw	0.001	NA	mg/L	
250502P034	4C	Human Resources 'C'-SK, 60 Second Draw	0.001	NA	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

NA: Sample not analyzed per customer request.

H: Sample result exceeds applicable regulatory limit.

Laboratory Report

NYE Report #: 2501947-33224

May 6, 2025

Project Manager
Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Project: Huntington Ufsd; Washington Primary School

Dear Project Manager,

Enclosed is the Laboratory Analytical Report for potable water sample(s) received on May 02, 2025. New York Environmental analyzed the samples on May 06, 2025 for Lead (Pb) by EPA Method 200.9 Rev. 2.2.

If there are any questions regarding the analyses, please feel free to contact us at your convenience. New York Environmental is a NELAP accredited laboratory. Attached reported results meet the requirements of the NELAP standards unless otherwise noted.

Samples' analytical results relate only to the samples tested, in the condition received by the laboratory. This report shall not be reproduced except in its entirety without written approval of the laboratory.

We sincerely thank you for your business, and look forward to being of service for your future environmental testing needs.

Sincerely,



Li Tsang, Laboratory Director

Date Collected:	02 May 2025
Date Received:	02 May 2025
Date Analyzed:	06 May 2025

Analytical Method:	EPA 200.9 Rev. 2.2
Analyte, Matrix:	Lead, Potable Water

Lab ID	CID	Sample Location/Description	LOQ	Result	Units	Flag
250502P001	1A	Kitchen Dishwash Station 'A' - SK, Initial	0.001	0.002	mg/L	
250502P002	1B	Kitchen Dishwash Station 'B' - SK, 15 Second Draw	0.001	NA	mg/L	
250502P003	1C	Kitchen Dishwash Station 'C' - SK, 60 Second Draw	0.001	NA	mg/L	
250502P004	2A	Kitchen Dishwash Station 2-left Bay 'A' - SK, Initial	0.001	<0.001	mg/L	
250502P005	2B	Kitchen Dishwash Station 2-left Bay 'B' - SK, 15 Second Draw	0.001	NA	mg/L	
250502P006	2C	Kitchen Dishwash Station 2-left Bay 'C' - SK, 60 Second Draw	0.001	NA	mg/L	

Comment:

CID: Client ID LOQ: Limit of Quantitation

NA: Sample not analyzed per customer request.